

BID #1903888
Designed in Burlington, WA


ENVISION NW

Roof

Reviewed for code compliance
with IRC 2015
Kitsap County Building Department
lasmith@co.kitsap.wa.us
11/13/2020

BASIC PERMIT PACKAGE
REVIEWED FOR CODE COMPLIANCE
WITH IRC 2015
KITSAP COUNTY BUILDING DEPARTMENT

7/11/2019

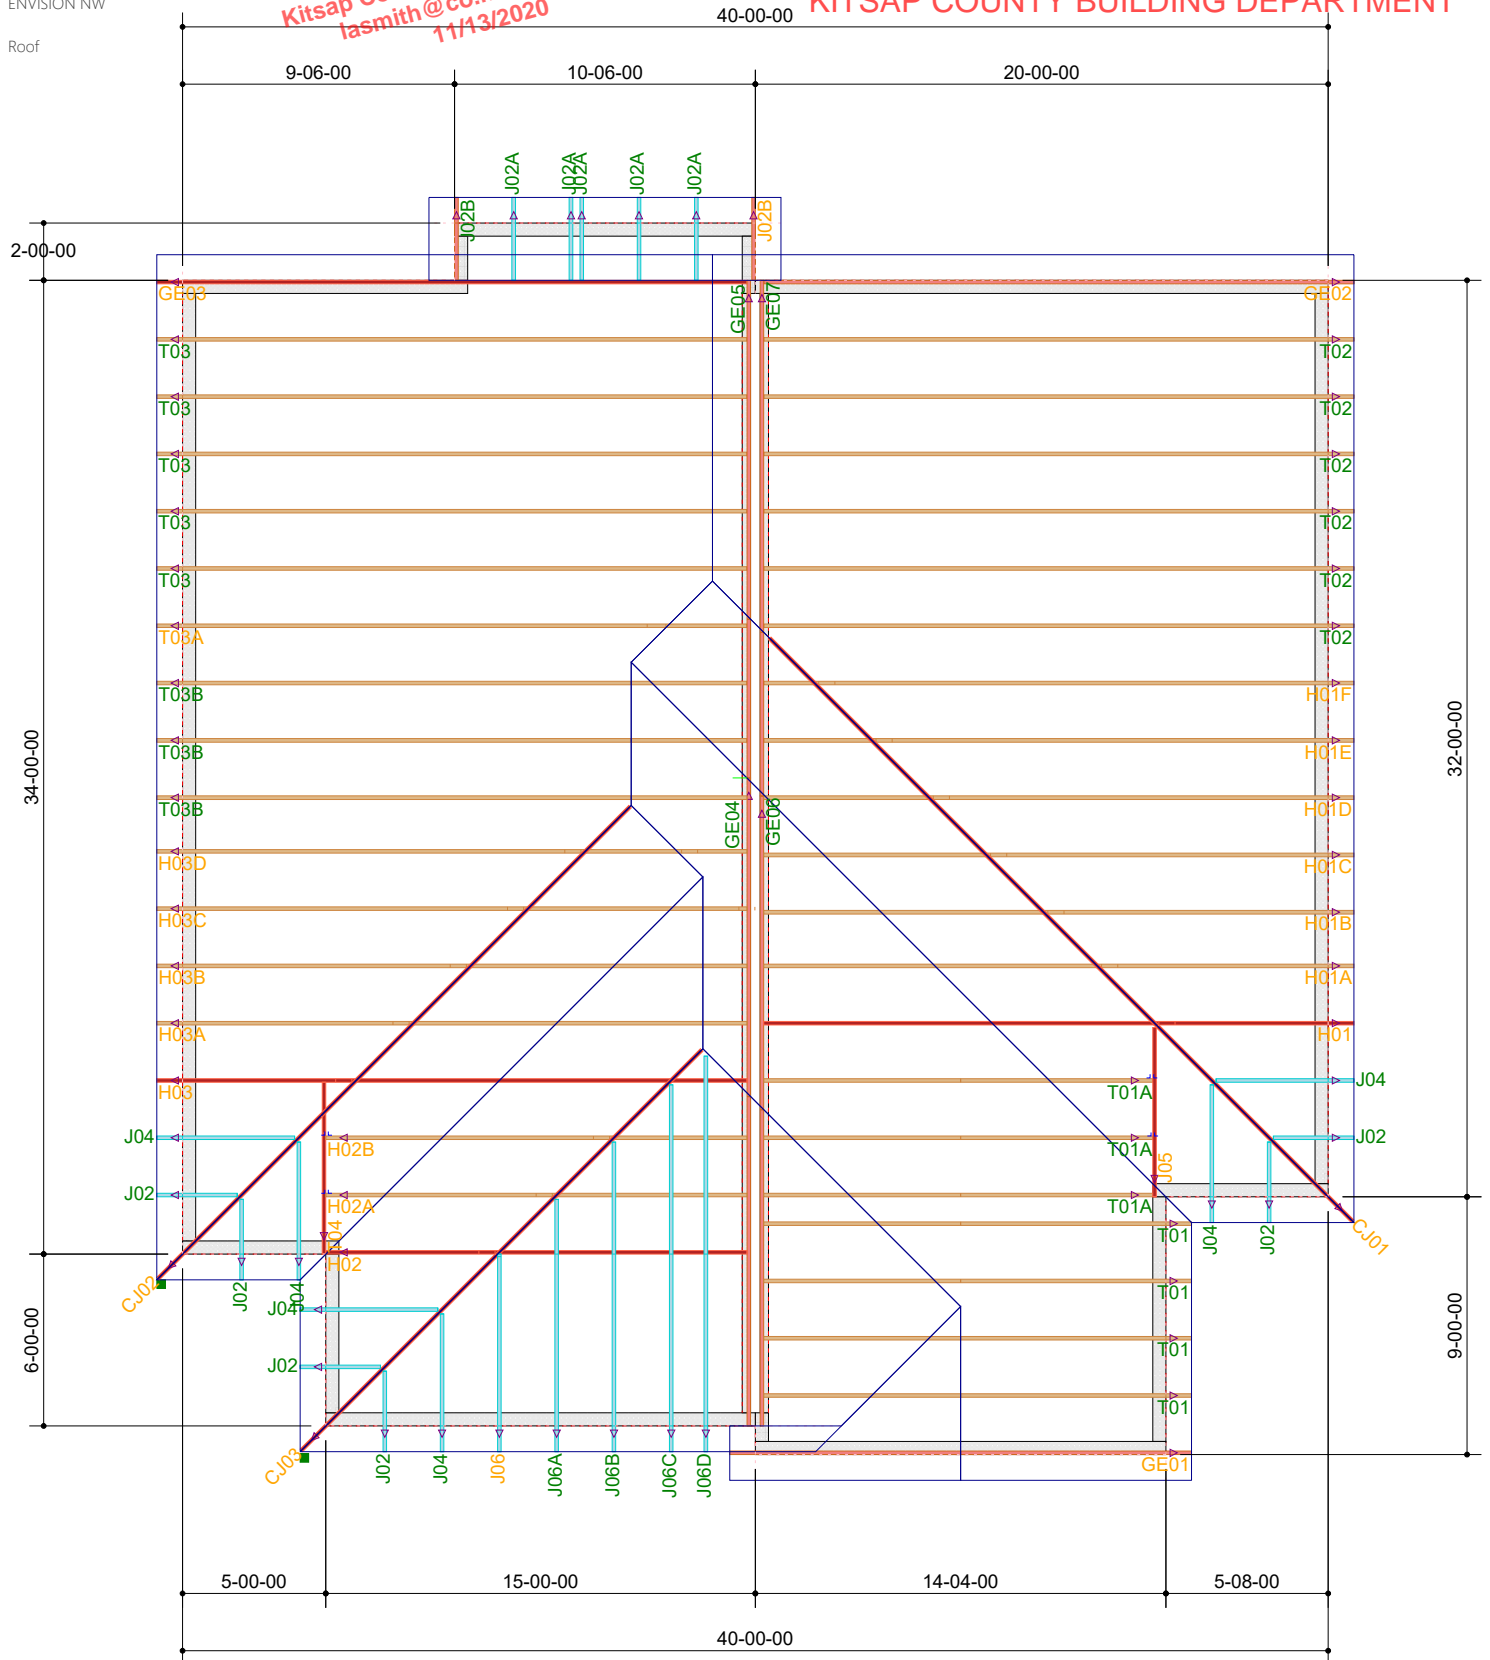

BID #1903888
ENVISION NW
SILVERDALE, WA 98383-9521

Sales:
Jeremiah Murphy



Roof: 6.00/12 Overhang: 10-12

Ceiling: Flat Spacing: 24"


30 PSF SNOW LOAD
All Gables dropped for 2x4 outlookers

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE01	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:29 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-t3carqZZDvCk6O3aXUw6XUbsh0NQymW5XwcWdnyz1aS



Scale = 1:27.1

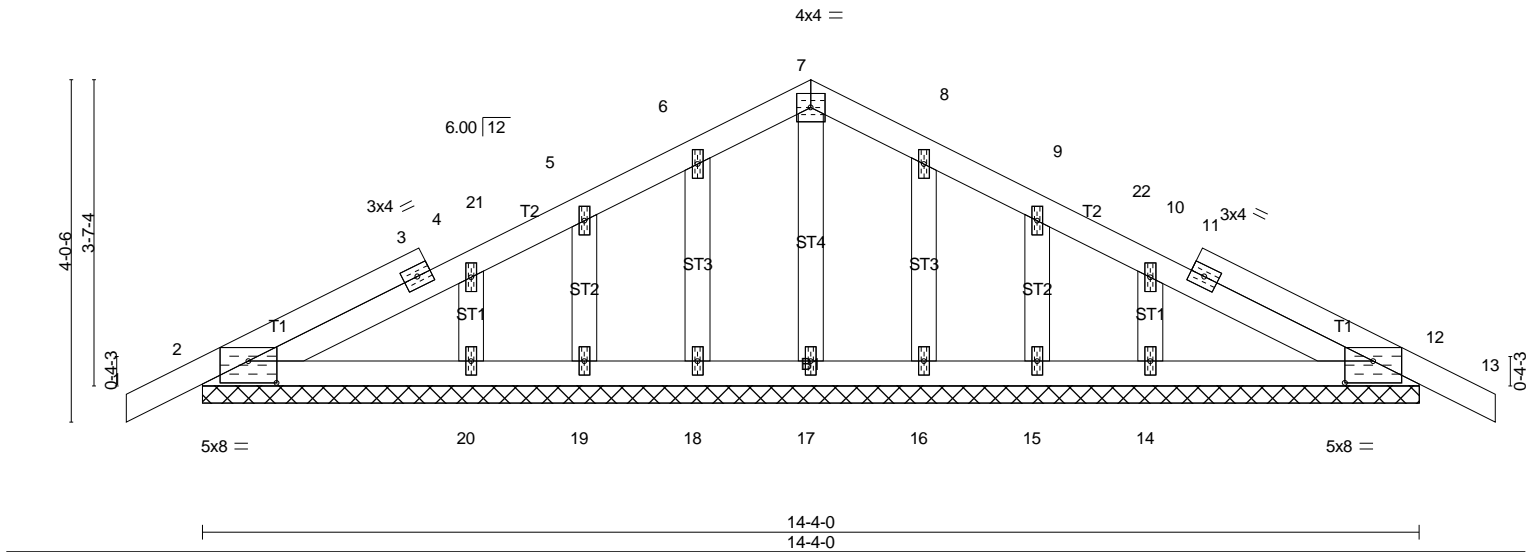


Plate Offsets (X,Y)-- [2:0-4-0,0-3-1], [12:0-4-0,0-3-1]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	0.00 12	n/r	120	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	0.00 12	n/r	90		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00 12	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
								Weight: 68 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 14-4-0.
(lb) - Max Horz 2=60(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 18, 19, 20, 16, 15, 14
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 18, 19, 20, 16, 15, 14

FORCES. (lb) - Max. Comp/Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-12 to 2-8-7, Exterior(2) 2-8-7 to 7-2-0, Corner(3) 7-2-0 to 10-9-3, Exterior(2) 10-9-3 to 15-2-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 18, 19, 20, 16, 15, 14.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE02	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:33 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyzt1pO-mrr5hBc3G8i9b0NLmJ_2hKISldhRuYShSXakmYyz1aO

-0-10-12 19-8-8
0-10-12 19-8-8

Scale = 1:56.7

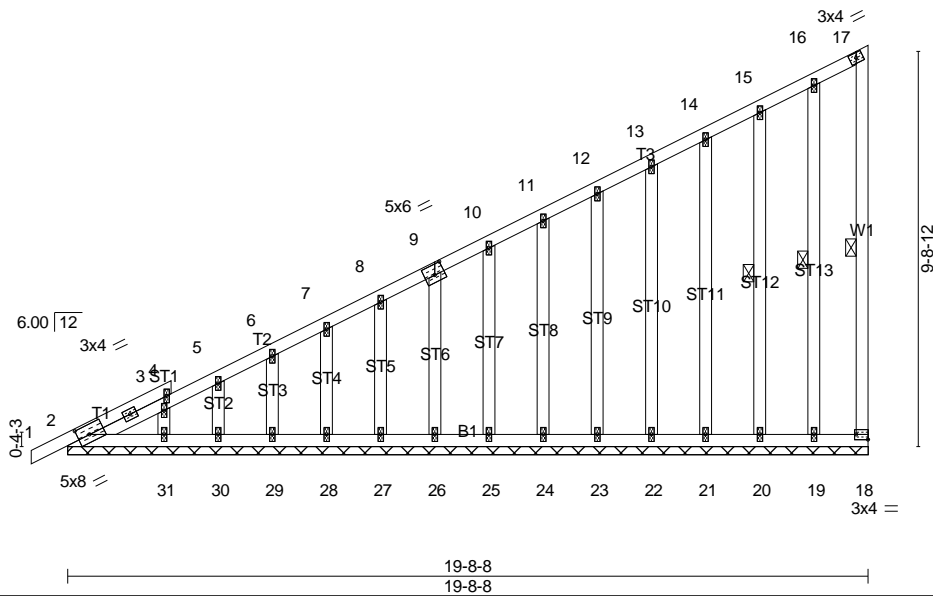


Plate Offsets (X,Y)-- [2:0-3-8,0-2-13], [9:0-3-0,0-3-0], [18:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	0.00	1	n/r	120	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	0.00	1	n/r	80		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	18	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 156 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 17-18, 16-19, 15-20

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 19-8-8.
(lb) - Max Horz 2=369(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 18, 2, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31
Max Grav All reactions 250 lb or less at joint(s) 18, 2, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-543/267, 3-4=-530/257, 4-5=-529/264, 5-6=-503/257, 6-7=-471/245, 7-8=-441/235, 8-9=-410/224, 9-10=-379/214, 10-11=-348/203, 11-12=-318/192, 12-13=-287/182, 13-14=-257/171

NOTES-

- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-12 to 2-8-7, Exterior(2) 2-8-7 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18, 2, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- No notches allowed in overhang and 1012 from left end and 0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE04	Roof Special Supported Gable	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:42 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO?ZuVaGjj9vrtAOZ4oif9ZDd3_FpHVeH?WRFiaWyz1af

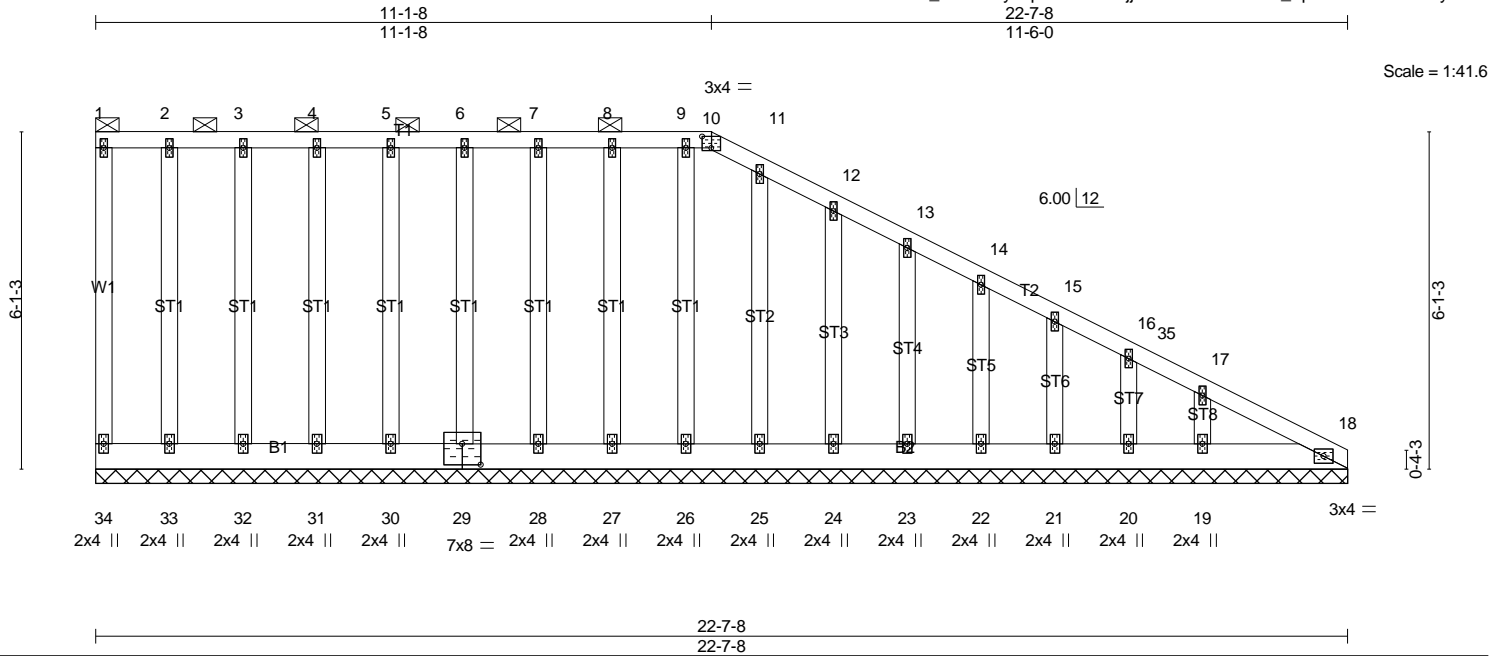


Plate Offsets (X,Y)-- [10:0-2-0,0-2-8], [29:0-4-0,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	18	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
								Weight: 174 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x6 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-10.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 22-7-8.
(lb) - Max Horz 34=218(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 34, 33, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 19
Max Grav All reactions 250 lb or less at joint(s) 34, 18, 33, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 19

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 15-16=265/133, 16-35=285/138, 17-35=290/131, 17-18=338/161
BOT CHORD 33-34=147/328, 32-33=147/328, 31-32=147/328, 30-31=147/328, 29-30=147/328, 28-29=147/327, 27-28=147/327, 26-27=147/327, 25-26=147/327, 24-25=147/327, 23-24=147/327, 22-23=147/327, 21-22=147/327, 20-21=147/327, 19-20=147/327, 18-19=147/327

NOTES-

- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-0-0, Exterior(2) 4-0-0 to 11-1-8, Corner(3) 11-1-8 to 14-8-0, Exterior(2) 14-8-0 to 22-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 34, 33, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 19.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 18.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE05	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:46 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-uL70PemDC8LJf0sr1Yj5j3ocMt_LROtbR3Dwjlyz1aB

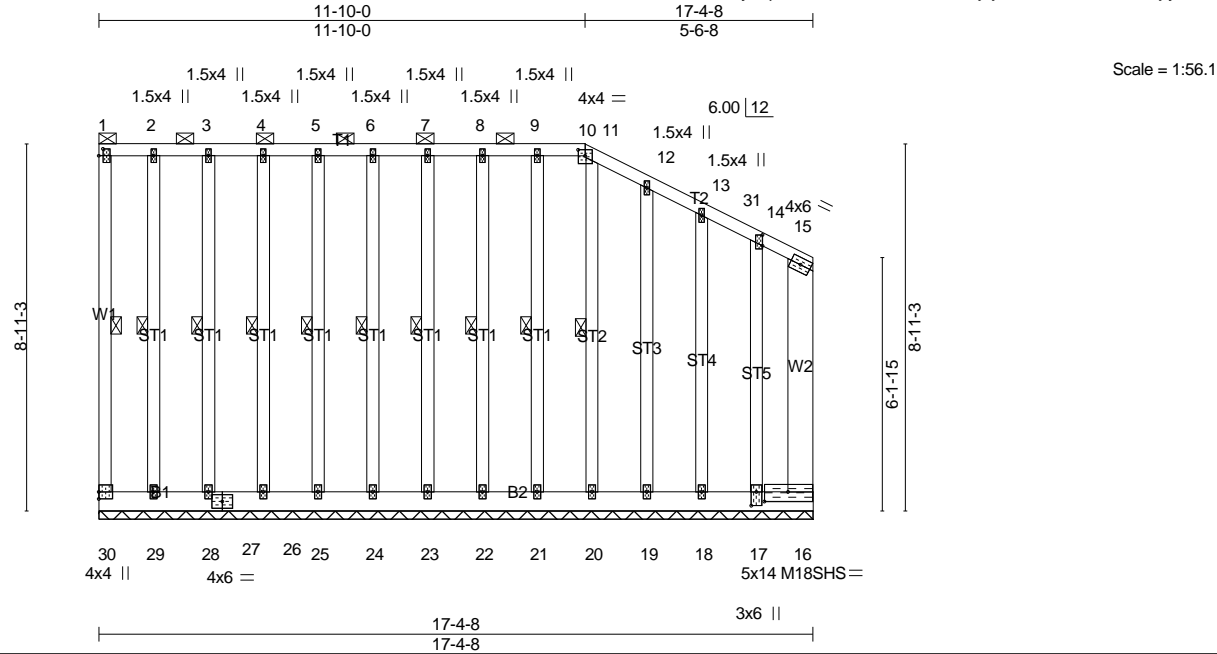


Plate Offsets (X,Y)-- [1:0-2-0,0-1-4], [10:0-0-0,0-1-12], [10:0-2-0,0-1-12], [11:0-1-12,0-0-14], [14:0-3-2,0-0-0], [16:0-6-14,0-2-12], [17:0-4-0,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	30.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	n/a - n/a	999	MT20 220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	n/a - n/a	999	M18SHS 220/195
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.00 16	n/a	
BCDL	8.0	Code IRC2015/TPI2014		Matrix-R					Weight: 216 lb FT = 0%

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-10.
BOT CHORD	2x6 DF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 DF No.2 *Except*		7-0-1 oc bracing: 16-17.
	W2: 2x8 DF SS	WEBS	1 Row at midpt 1-30, 2-29, 3-28, 4-26, 5-25, 6-24, 7-23, 8-22, 9-21, 11-20
OTHERS	2x4 DF No.2		

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 17-4-8.
(lb) - Max Horz 30=-307(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 28, 26, 25, 24, 23, 22, 21, 20, 19 except 30=-127(LC 8), 16=-708(LC 11), 29=-126(LC 9), 18=-114(LC 9), 17=-1320(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 30, 29, 28, 26, 25, 24, 23, 22, 21, 20, 19, 18 except 16=1179(LC 8), 17=858(LC 11)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 14-15=-495/330, 15-16=-686/459
BOT CHORD 29-30=-309/428, 28-29=-309/428, 27-28=-309/428, 26-27=-309/428, 25-26=-309/428, 24-25=-309/428, 23-24=-309/428, 22-23=-309/428, 21-22=-309/428, 20-21=-309/428, 19-20=-309/428, 18-19=-309/428, 17-18=-309/428, 16-17=-309/428
WEBS 14-17=-473/696

- NOTES-**
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-0-0, Exterior(2) 4-0-0 to 11-10-0, Corner(3) 11-10-0 to 15-5-3, Exterior(2) 15-5-3 to 17-0-14 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE05	GABLE	1	1	Job Reference (optional)

- NOTES-**
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 28, 26, 25, 24, 23, 22, 21, 20, 19 except (jt=lb) 30=127, 16=708, 29=126, 18=114, 17=1320.
 - 12) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE06	Roof Special Supported Gable	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:50 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyZ1pO-m6NWF?pkGMrl7dAcGOo1uvyN2UUZNFtBMhB7s3yz1a7

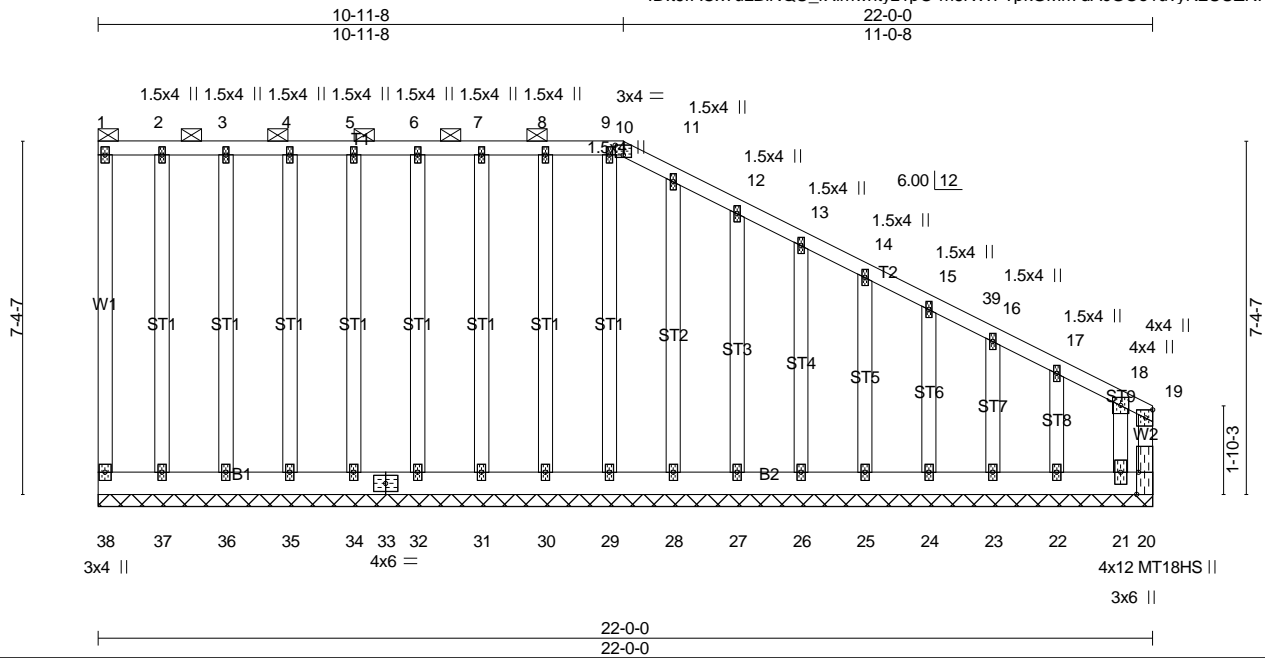


Plate Offsets (X,Y)-- [10:0-2-0,0-2-8], [20:0-5-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL 1.15	TC 0.41	Vert(LL)	n/a	-	n/a	MT20	220/195
TCDL 7.0	Lumber DOL 1.15	BC 0.22	Vert(CT)	n/a	-	n/a	MT18HS	220/195
BCLL 0.0 *	Rep Stress Incr YES	WB 0.07	Horz(CT)	0.01	20	n/a		
BCDL 8.0	Code IRC2015/TPI2014	Matrix-R						
							Weight: 202 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x6 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-10. Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 22-0-0.
(lb) - Max Horz 38=-262(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 38, 37, 36, 35, 34, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22 except 20=-165(LC 11), 21=-625(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 38, 37, 36, 35, 34, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21 except 20=682(LC 8)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 15-39=-277/149, 16-39=-280/143, 16-17=-307/158, 17-18=-346/173, 18-19=-554/272, 19-20=-585/289
BOT CHORD 37-38=-201/379, 36-37=-201/379, 35-36=-201/379, 34-35=-201/379, 33-34=-201/379, 32-33=-201/379, 31-32=-201/379, 30-31=-201/379, 29-30=-201/379, 28-29=-201/379, 27-28=-201/379, 26-27=-201/379, 25-26=-201/379, 24-25=-201/379, 23-24=-201/379, 22-23=-201/379, 21-22=-201/379, 20-21=-201/379
WEBS 18-21=-241/460

NOTES-

- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-0-0, Exterior(2) 4-0-0 to 10-11-8, Corner(3) 10-11-8 to 14-8-0, Exterior(2) 14-8-0 to 21-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 38, 37, 36, 35, 34, 32, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22 except (jt=lb) 20=165, 21=625.

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE06	Roof Special Supported Gable	1	1	Job Reference (optional)

- NOTES-**
- 12) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE07	Roof Special Supported Gable	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248 8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:53 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-Bh3fu1scZHDk_4vBxWLkVYalUhROaVdd2fQnTOyz1a4

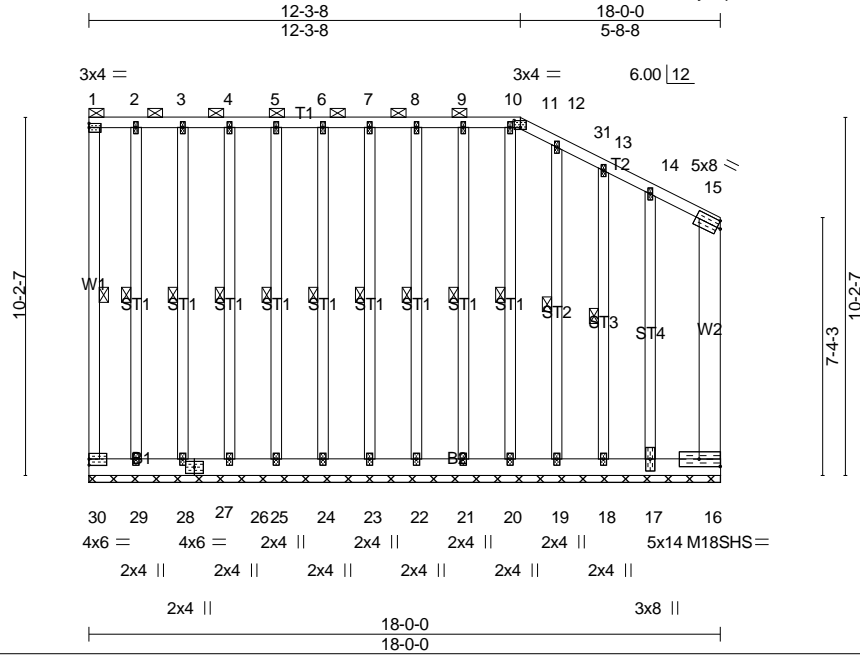


Plate Offsets (X,Y)-- [11:0-2-0,0-2-8], [16:Edge,0-2-8]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP
TCLL	30.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	n/a - n/a	999	MT20	220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	n/a - n/a	999	M18SHS	220/195
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.00 16	n/a n/a		
BCDL	8.0	Code IRC2015/TPI2014		Matrix-R					Weight: 245 lb	FT = 0%

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-11.
BOT CHORD	2x6 DF No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	B2: 2x6 DF 2400F 2.0E	WEBS	1 Row at midpt 1-30, 2-29, 3-28, 4-26, 5-25, 6-24, 7-23, 8-22, 9-21, 10-20, 12-19, 13-18
OTHERS	2x4 DF No.2		

REACTIONS.	
All bearings 18-0-0.	
(lb) - Max Horz 30=-352(LC 8)	
Max Uplift All uplift 100 lb or less at joint(s) 28, 26, 25, 24, 23, 22, 21, 20 except 30=-187(LC 8), 16=-659(LC 11), 29=-179(LC 9), 19=-111(LC 8), 18=-233(LC 9), 17=-1360(LC 8)	
Max Grav All reactions 250 lb or less at joint(s) 30, 29, 28, 26, 25, 24, 23, 22, 21, 20, 19 except 16=1063(LC 8), 18=392(LC 10), 17=936(LC 11)	

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	14-15=-455/316, 15-16=-579/399
BOT CHORD	29-30=-354/478, 28-29=-354/478, 27-28=-354/478, 26-27=-354/478, 25-26=-354/478, 24-25=-354/478, 23-24=-354/478, 22-23=-354/478, 21-22=-354/478, 20-21=-354/478, 19-20=-354/478, 18-19=-354/478, 17-18=-354/478, 16-17=-354/478
WEBS	14-17=-481/700

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-0-0, Exterior(2) 4-0-0 to 12-3-8, Corner(3) 12-3-8 to 16-0-0, Exterior(2) 16-0-0 to 17-8-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 6) Gable requires continuous bottom chord bearing.
 - 7) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 8) Gable studs spaced at 1-4-0 oc.
 - 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 28, 26, 25, 24, 23, 22, 21, 20 except (jt=lb) 30=187, 16=659, 29=179, 19=111, 18=233, 17=1360.

Continued on page 2


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE07	Roof Special Supported Gable	1	1	Job Reference (optional)

- NOTES-**
- 12) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Louws Truss, Inc., Ferndale, WA 98248

Scale = 1:9.4

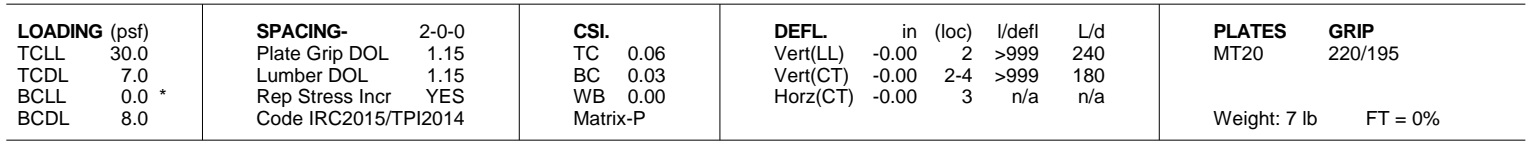

REACTIONS. (lb/size) 3=51/Mechanical, 2=171/0-5-8 (min. 0-1-8), 4=15/Mechanical
 Max Horz 2=50(LC 12)
 Max Uplift 3=30(LC 12), 2=37(LC 12)
 Max Grav 3=51(LC 1), 2=171(LC 1), 4=33(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J02A	Jack-Open	5	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:54 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-uQEjhutB1vgpS3w0qx2UPcLCHKmNCTc4eiW6Lyz1Z7

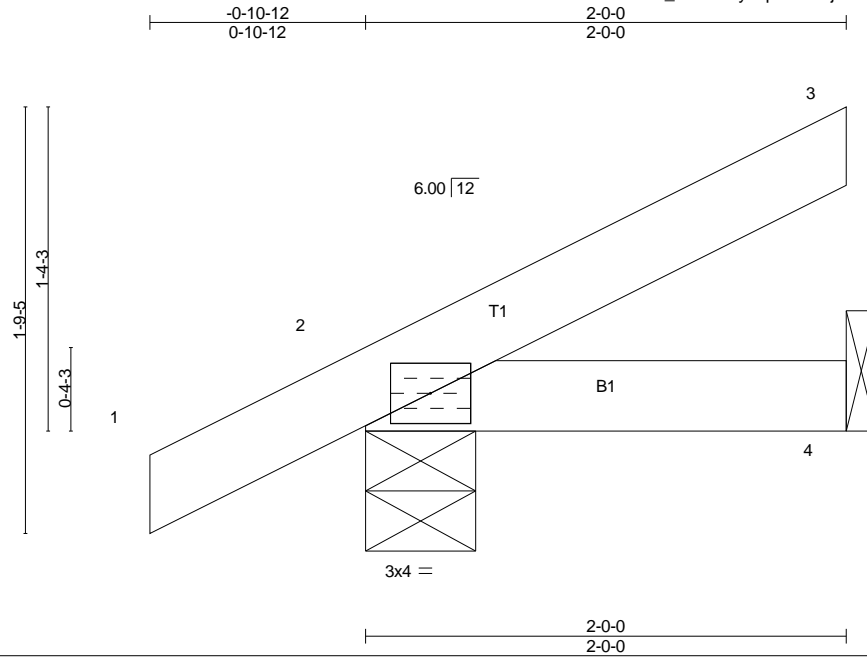

Scale = 1:9.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	-0.00	2-4	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.01	2-4	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00		n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P						Weight: 7 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 2-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=174/0-5-8 (min. 0-1-8), 4=71/Mechanical
Max Horz 2=51(LC 9)
Max Uplift 2=-40(LC 9), 4=-19(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Louws Truss, Inc., Ferndale, WA 98248

Scale = 1:9.6



LUMBER- TOP CHORD 2x4 DF No.2 BOT CHORD 2x4 DF No.2 WEBS 2x4 DF No.2	BRACING- TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide. </div>
--	--

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCdL=4.2psf; BCdL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J04	Jack-Open	6	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:00 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-jac_xxgentgpXNW3N52SjgsNbiPbnwMUSa9qK?yz1Z1

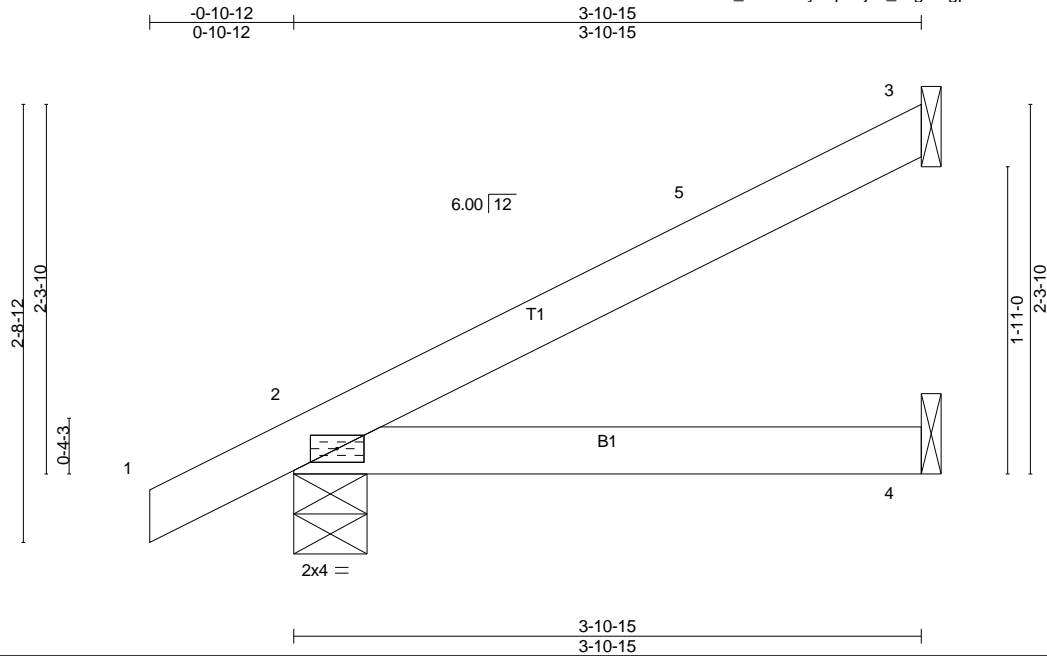

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.20	Vert(LL) -0.01	2-4	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT) -0.02	2-4	>999	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) -0.00	3	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 13 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 3-10-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 3=121/Mechanical, 2=259/0-5-8 (min. 0-1-8), 4=29/Mechanical
Max Horz 2=86(LC 12)
Max Uplift 3=-67(LC 12), 2=-46(LC 12)
Max Grav 3=121(LC 1), 2=259(LC 1), 4=65(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 3-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J06	Jack-Open	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:07 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyzy1pO-0wXdPKI171YqtSZQH3g5V9eUIWIEw45W39Li25yz1Yw

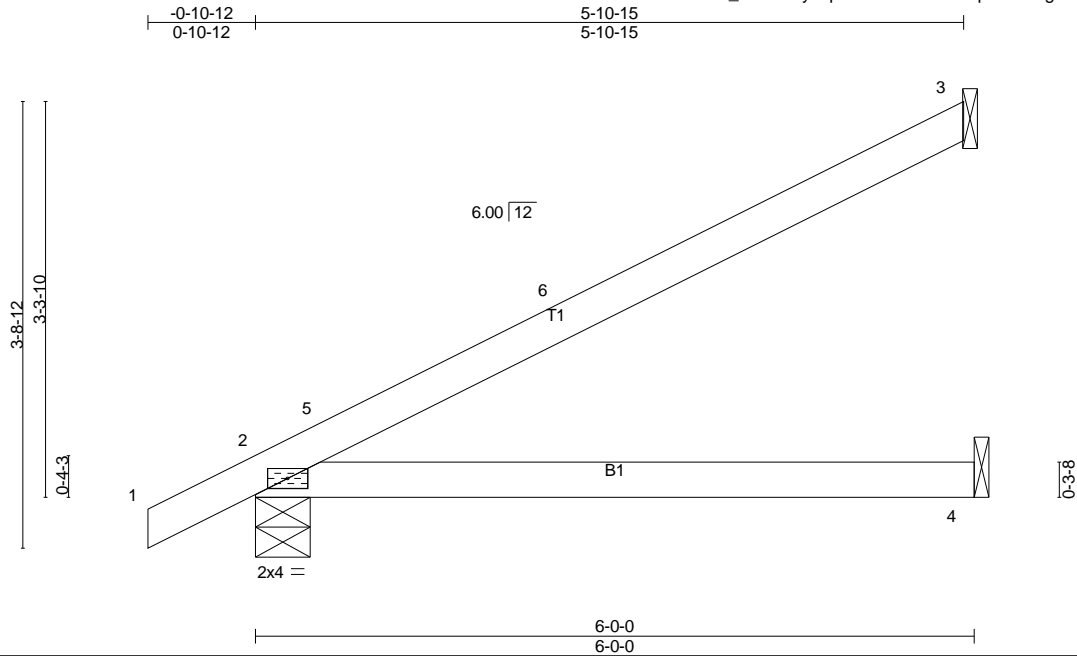

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.59	Vert(LL)	-0.06	2-4	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.10	2-4	>683	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P						Weight: 19 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-10-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 3=200/Mechanical, 2=345/0-5-8 (min. 0-1-8), 4=46/Mechanical
Max Horz 2=124(LC 12)
Max Uplift 3=107(LC 12), 2=54(LC 12)
Max Grav 3=200(LC 1), 2=345(LC 1), 4=103(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 5-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 3=107.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J06A	Jack-Open	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:10 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-QVCm2MnvQxwOkwH_yBEo7nG_9knx7Rqyl7aMfQyz1Yt

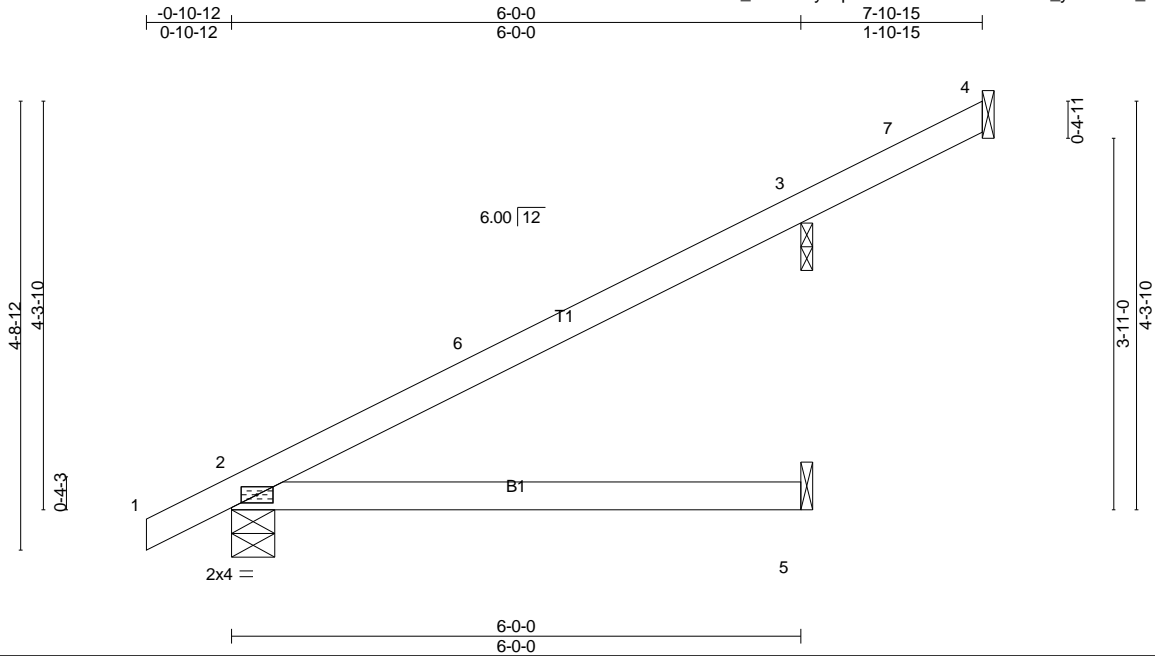

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.64	Vert(LL)	-0.06	2-5	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.10	2-5	>683	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P						Weight: 22 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings Mechanical except (jt=length) 2=0-5-8, 3=0-1-8.

(lb) - Max Horz 2=157(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 4, 2 except 3=-145(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 4, 5 except 2=353(LC 1), 3=274(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 7-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 3.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2 except (jt=lb) 3=145.
- 7) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 3.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Louws Truss, Inc., Ferndale, WA 98248 8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:14 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-JGSHukqQUARqCXbmB1kHdRf9L8t3FpYglYaoByz1Yp



LUMBER- TOP CHORD 2x4 DF No.2 BOT CHORD 2x4 DF No.2	BRACING- TOP CHORD BOT CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins. Rigid ceiling directly applied or 10-0-0 oc bracing.
		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J06C	Jack-Open	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:18 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyZ1pO-B1hnj5twYPxGh9uXQtNgSTcl8yWp?3p8bNWnxysz1Yl

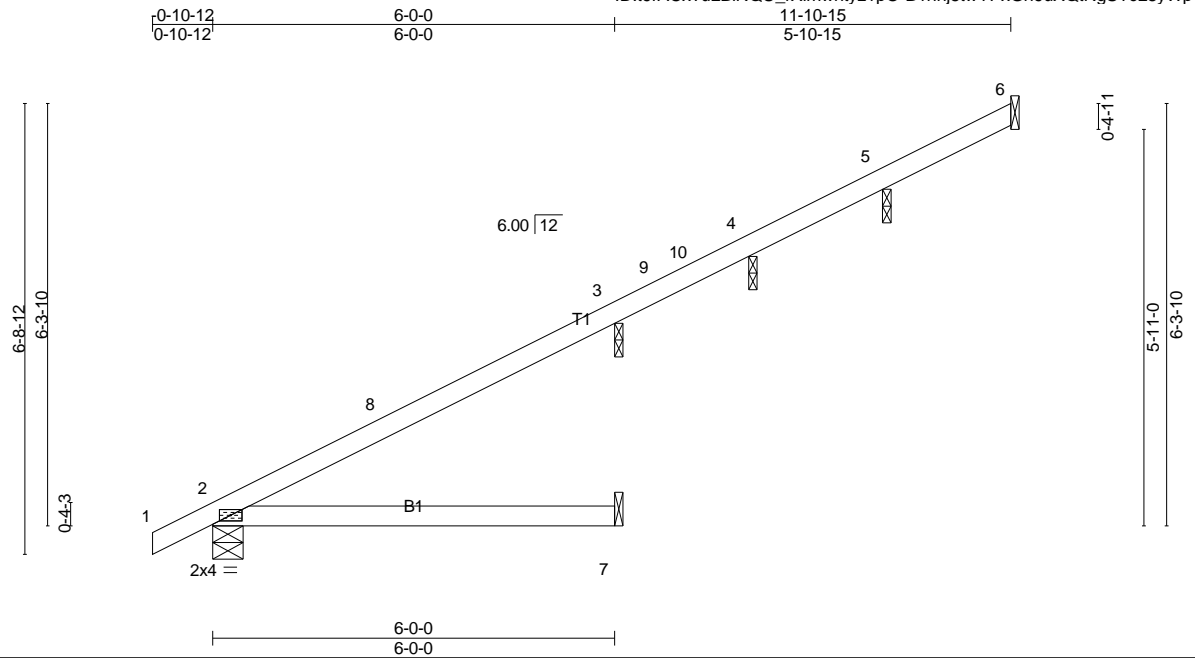

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.64	Vert(LL) -0.06	2-7	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.30	Vert(CT) -0.10	2-7	>683	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) -0.00	6	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-P					Weight: 28 lb	FT = 0%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 0-1-8 except (jt=length) 6=Mechanical, 2=0-5-8, 7=Mechanical.

(lb) - Max Horz 2=209(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 6, 2, 4, 5 except 3=149(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 6, 7, 4, 5 except 2=353(LC 1), 3=282(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 11-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 3, 4, 5.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 4, 5 except (jt=lb) 3=149.
- 7) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 3, 4, 5.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J06D	Jack-Open	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:22 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-4pxlZTxRbdRhAmClfjRccJm18ZltxtjW?U?4jyz1Yh

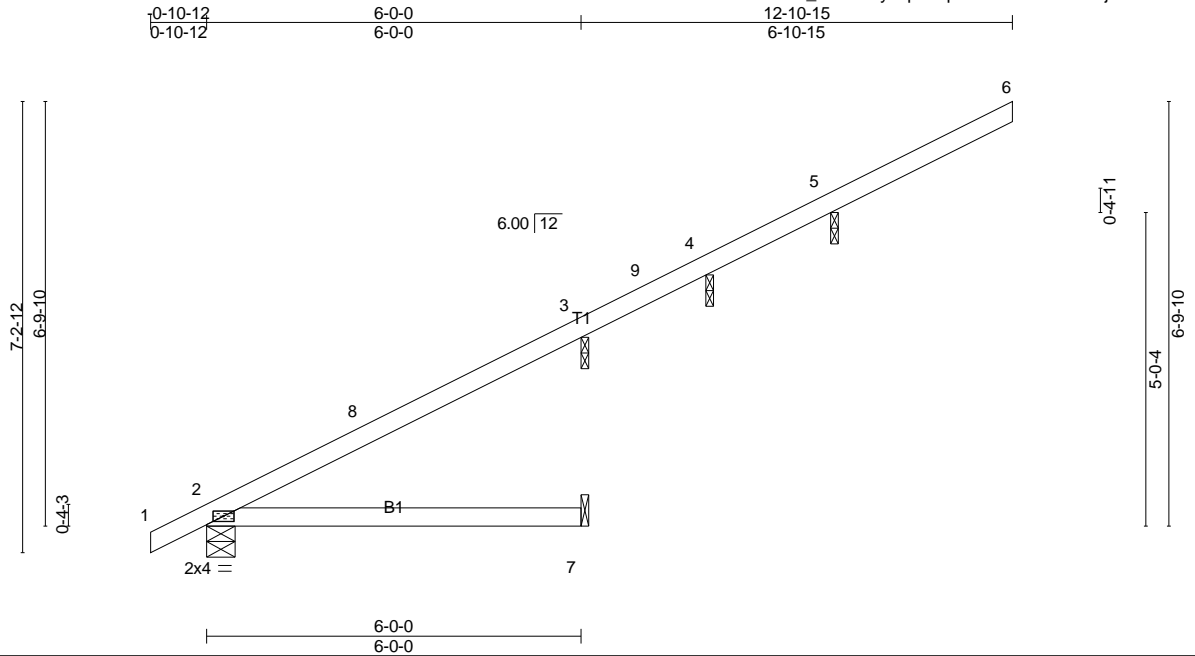

LOADING (psf)	SPACING-	CS.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.64	Vert(LL) -0.06	2-7	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.30	Vert(CT) -0.10	2-7	>683	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) -0.00	5	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-P					Weight: 29 lb	FT = 0%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 0-1-8 except (jt=length) 2=0-5-8, 7=Mechanical.

(lb) - Max Horz 2=215(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 2, 4 except 3=-149(LC 12), 5=-194(LC 9)

Max Grav All reactions 250 lb or less at joint(s) 7, 4 except 2=353(LC 1), 3=282(LC 1), 5=435(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 12-10-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 3, 4, 5.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4 except (jt=lb) 3=149, 5=194.
- 7) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 3, 4, 5.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T01	Common	4	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:25 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-UOcRBUzJuYpG1DxtKr?JExOYTnq98DkACzifh2yz1Ye

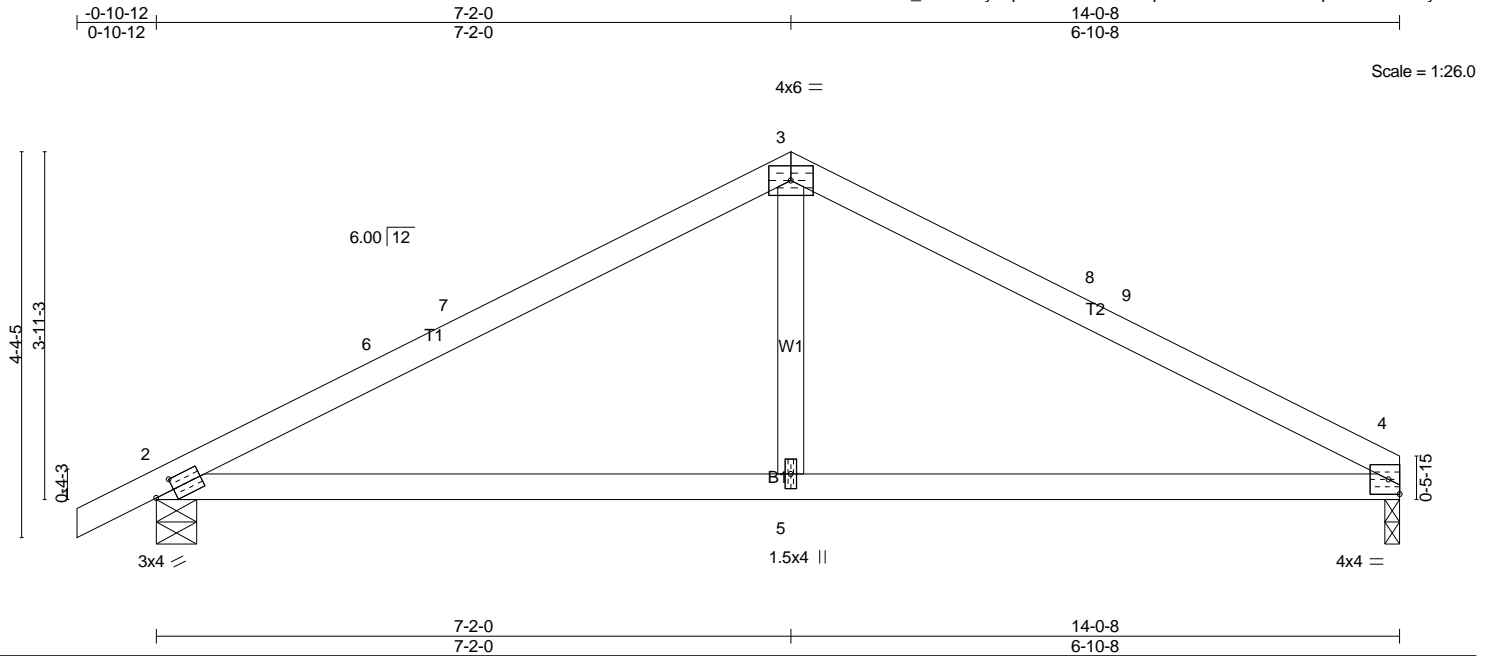


Plate Offsets (X,Y)-- [2:0-2-10,0-1-8]		7-2-0		14-0-8	
		7-2-0		6-10-8	
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.70	in (loc) l/defl L/d	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.52	Vert(LL) -0.09 4-5 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Vert(CT) -0.13 4-5 >999 180		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.01 4 n/a n/a		
	Code IRC2015/TPI2014			Weight: 47 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-7-1 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 4=614/0-2-0 (min. 0-1-8), 2=704/0-5-8 (min. 0-1-8)
Max Horz 2=72(LC 12)
Max Uplift 4=-96(LC 13), 2=-126(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-6=-884/162, 6-7=-769/165, 3-7=-764/179, 3-8=-759/193, 8-9=-768/179, 4-9=-885/179
BOT CHORD 2-5=-83/678, 4-5=-83/678
WEBS 3-5=0/295

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 7-2-0, Exterior(2) 7-2-0 to 10-9-3, Interior(1) 10-9-3 to 13-11-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=126.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T01A	Common	3	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:28 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-uzlZqW?CBTBruhS0zY0sa02w_ssLaUcuxxJINyz1Yb

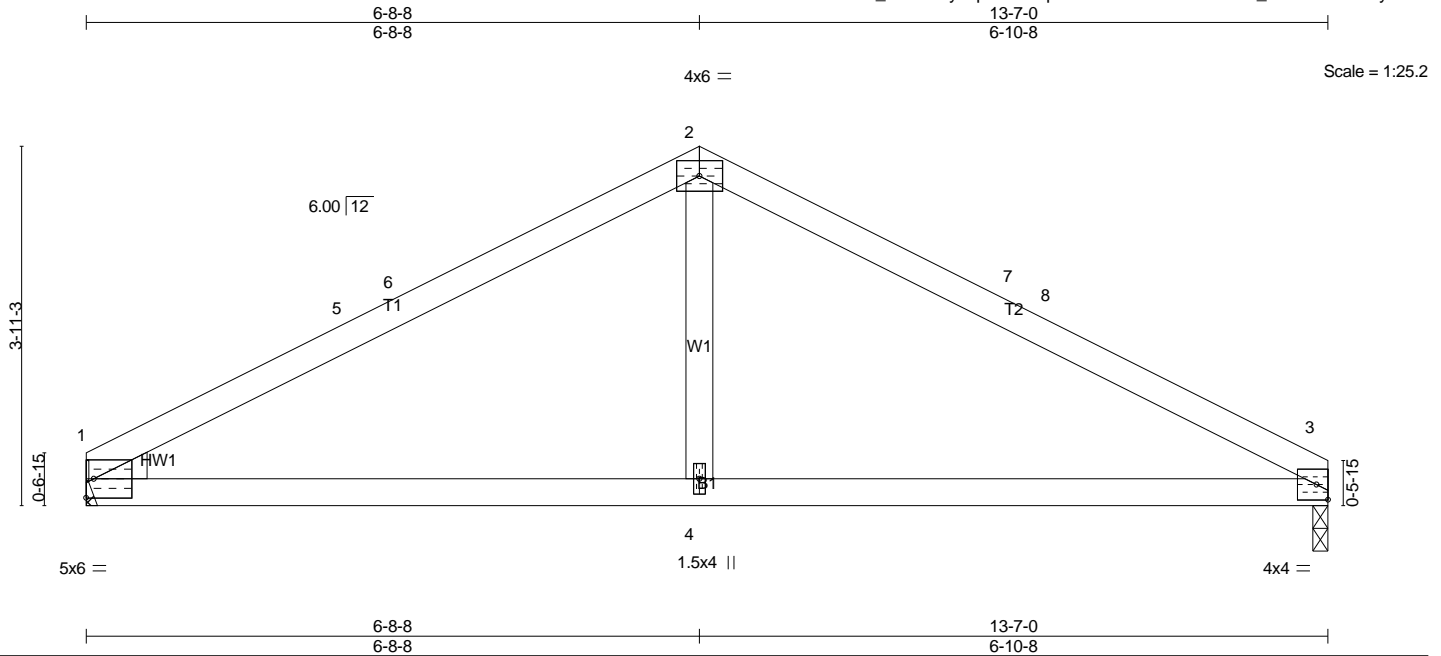


Plate Offsets (X,Y)-- [1:0-0-8,0-0-4], [1:0-5-11,0-0-8]									
LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES
TCLL 30.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.09	3-4	>999	240	MT20
TCDL 7.0	Lumber DOL	1.15	BC 0.52	Vert(CT)	-0.13	3-4	>999	180	GRIP
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.01	3	n/a	n/a	220/195
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						Weight: 45 lb
									FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2
WEDGE
Left: 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-7-10 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 3=605/0-2-0 (min. 0-1-8), 1=605/Mechanical
Max Horz 1=-58(LC 13)
Max Uplift3=-96(LC 13), 1=-94(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-5=-865/180, 5-6=-749/180, 2-6=-738/194, 2-7=-737/193, 7-8=-746/179, 3-8=-863/179
BOT CHORD 1-4=-83/658, 3-4=-83/658
WEBS 2-4=0/290

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-12 to 3-7-15, Interior(1) 3-7-15 to 6-8-8, Exterior(2) 6-8-8 to 10-3-11, Interior(1) 10-3-11 to 13-6-0 zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 3.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 1.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T02	Monopitch	6	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:31 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-JY_iSY24UOaQl8O1h66jUCebbCqSYtN2au9zviyz1YY

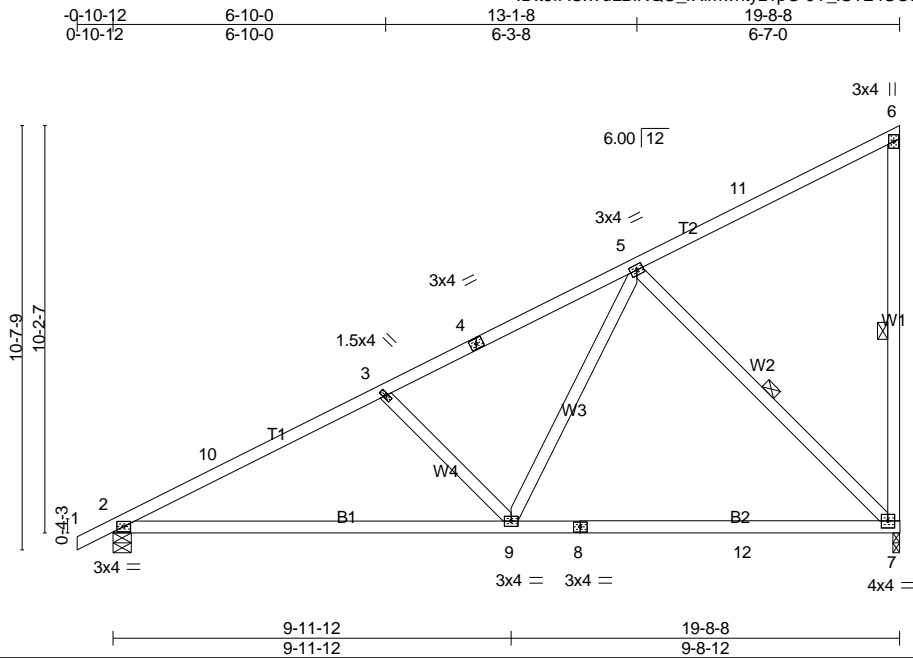

Scale = 1:57.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.53	Vert(LL) -0.30	7-9	>763	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.71	Vert(CT) -0.44	7-9	>525	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.30	Horz(CT) 0.02	7	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014						Weight: 99 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-4-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-7, 5-7

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=381(LC 9)
Max Uplift 7=-234(LC 12), 2=-167(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-1405/214, 3-10=-1308/229, 3-4=-1054/182, 4-5=-871/204
BOT CHORD 2-9=-366/1159, 8-9=-250/603, 8-12=-250/603, 7-12=-250/603
WEBS 3-9=-448/230, 5-9=-84/592, 5-7=-849/293

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=234, 2=167.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T03	Common	5	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

ID:t9rACx?uLBINQU_rXimwntyzt1pO-fVnbVF5DlxCirwH_UfhuBGLTuCY7D5BnkAtkawyz1YT

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:36 2019 Page 1

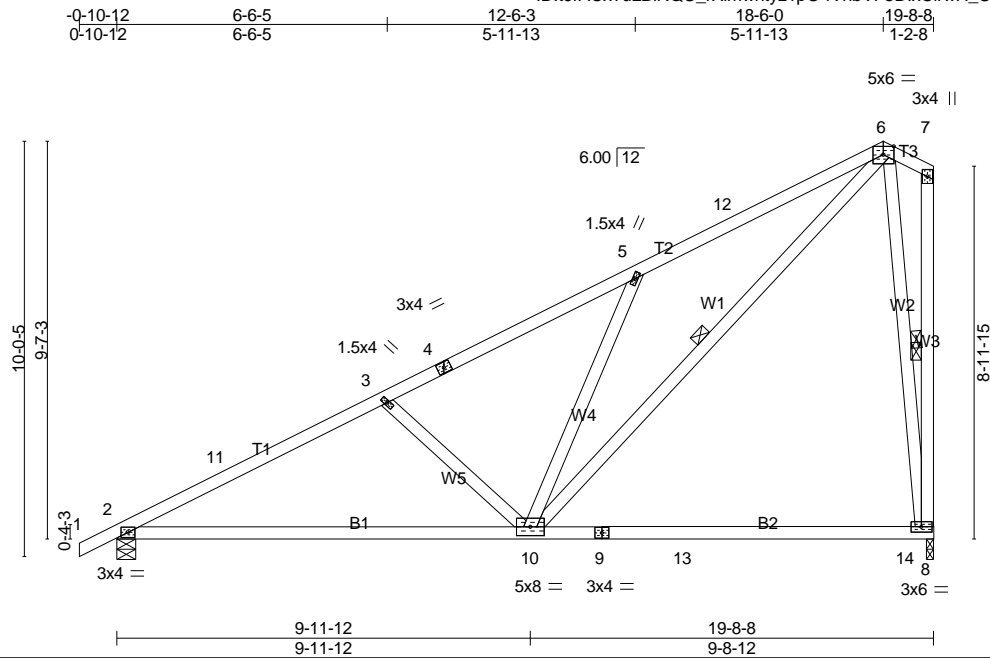

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.50	Vert(LL) -0.37	8-10	>625	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.75	Vert(CT) -0.52	8-10	>444	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Horz(CT) 0.02	8	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014						Weight: 114 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-10, 7-8, 6-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=956/0-5-8 (min. 0-1-8), 8=868/0-2-0 (min. 0-1-8)
Max Horz 2=347(LC 11)
Max Uplift 2=172(LC 12), 8=211(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-11=-1423/226, 3-11=-1333/240, 3-4=-1056/179, 4-5=-950/200, 5-12=-1333/449,
6-12=-1226/462
BOT CHORD 2-10=-377/1180
WEBS 3-10=-450/227, 5-10=-634/335, 6-10=-501/1465, 6-8=-848/442

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 18-6-0, Exterior(2) 18-6-0 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=172, 8=211.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T03A	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248 8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:40 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-YG06Ld9kM9i8KXamjVmqL6WB2qz19sANforyjhyz1YP

0-10-12 5-9-4 10-11-15 16-5-12 16-10-8 19-8-8
0-10-12 5-9-4 5-2-12 5-5-13 0-4-12 2-10-0

Scale = 1:50.2

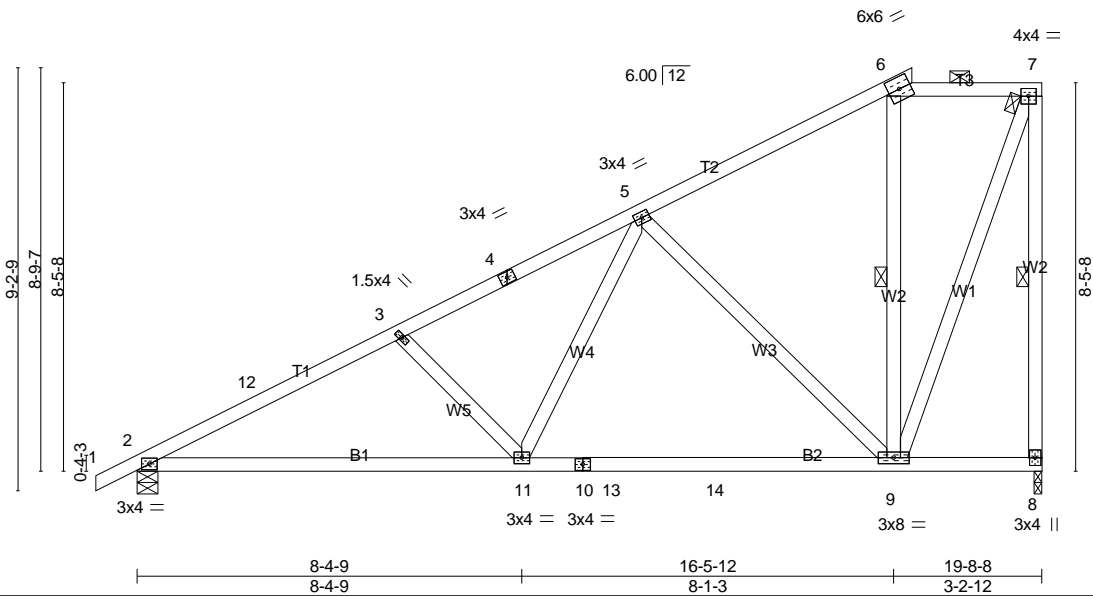

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.49	Vert(LL) -0.09 9-11 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.65	Vert(CT) -0.16 2-11 >999 180		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2015/TPI2014			Weight: 114 lb	FT = 0%

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.2	TOP CHORD Structural wood sheathing directly applied or 4-8-2 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD 2x4 DF No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 DF No.2	WEBS 1 Row at midpt 7-8, 6-9
	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 8=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=318(LC 9)
Max Uplift 8=170(LC 12), 2=177(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-12=-1465/241, 3-12=-1380/253, 3-4=-1176/202, 4-5=-1017/220, 5-6=-423/160, 6-7=-293/168, 7-8=-857/252
BOT CHORD 2-11=-416/1222, 10-11=-315/776, 10-13=-315/776, 13-14=-315/776, 9-14=-315/776
WEBS 3-11=-363/187, 5-11=-62/460, 5-9=-689/247, 7-9=-248/805


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 16-3-3, Exterior(2) 16-3-3 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=170, 2=177.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T03B	Common	3	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:43 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyzt1pO-yriEzeBcf44jB_JK0dKXzk8ah1xxMI4pLm3cK0yz1YM

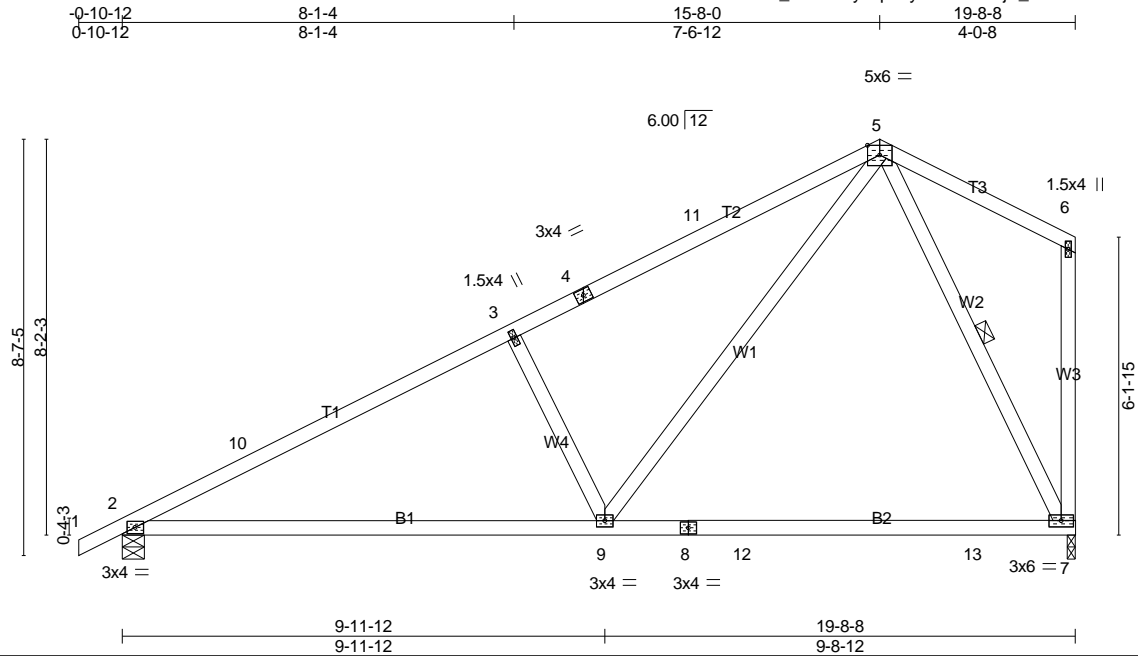

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.85	Vert(LL)	-0.36	7-9	>638	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.50	7-9	>468	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.32	Horz(CT)	0.02	7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 96 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-1-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-7

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=956/0-5-8 (min. 0-1-8), 7=868/0-2-0 (min. 0-1-8)
Max Horz 2=256(LC 11)
Max Uplift 2=179(LC 12), 7=158(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-10=-1365/214, 3-10=-1252/234, 3-4=-1113/245, 4-11=-980/257, 5-11=-967/271
BOT CHORD 2-9=-338/1111, 8-9=-166/350, 8-12=-166/350, 12-13=-166/350, 7-13=-166/350
WEBS 3-9=-574/293, 5-9=-213/885, 5-7=-766/258

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 15-8-0, Exterior(2) 15-8-0 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=179, 7=158.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	CJ03	Diagonal Hip Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:26 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-TUwSDoXgw_q9FxFxL?sLMPvrzJspJWINGfryNs0Syz1aV

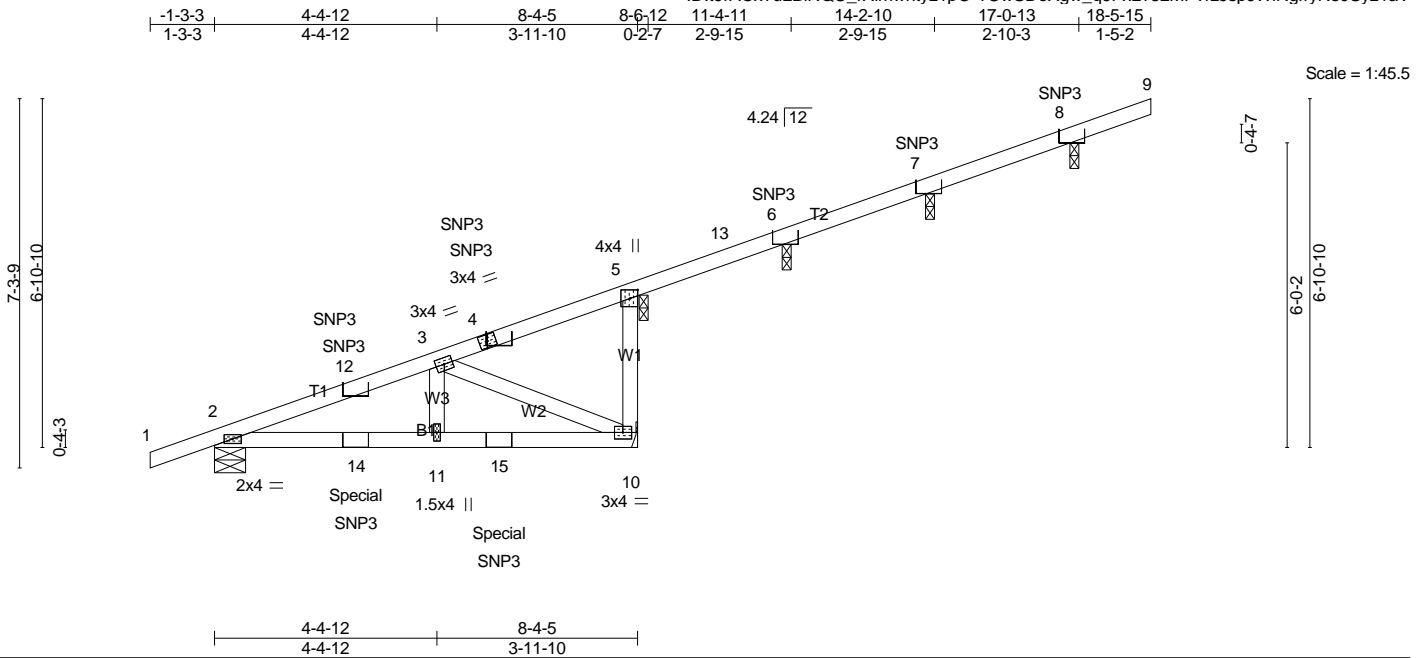


Plate Offsets (X,Y)-- [5:0-2-0,0-1-12]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.23	Vert(LL)	-0.01	11	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	-0.02	10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.15	Horz(CT)	0.01	10	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P							
									Weight: 51 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 0-2-2 except (jt=length) 10=Mechanical, 2=0-7-6.

(lb) - Max Horz 2=212(LC 5)

Max Uplift All uplift 100 lb or less at joint(s) 5, 10, 6, 7, 8 except 2=-118(LC 4)

Max Grav All reactions 250 lb or less at joint(s) 5, 6, 7, 8 except 10=254(LC 1), 2=500(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-12=-630/44, 3-12=-530/41

BOT CHORD 2-14=-173/537, 11-14=-173/537, 11-15=-173/537, 10-15=-173/537

WEBS 3-10=-582/202

NOTES-

- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5, 6, 7, 8.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 10, 6, 7, 8 except (jt=lb) 2=118.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 5, 6, 7, 8.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 2-9-8 from the left end to connect truss(es) J02 (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
- Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 5-7-7 from the left end to connect truss(es) J04 (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
- Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 11-3-5 from the left end to connect truss(es) J06A (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
- Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 14-1-4 from the left end to connect truss(es) J06B (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
- Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 16-11-3 from the left end to connect truss(es) J06C (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	CJ03	Diagonal Hip Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:26 2019 Page 2
ID:t9rACx?uLBINQU_rXimwntyz1pO-TUwSDoXgw_q9FxL?sLMPvrzJspJWINGfryNs0Syz1aV

NOTES-


- 15) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 2-9-8 from the left end to connect truss(es) J02 (1 ply 2x4 DF) to back face of top chord, skewed 45.0 deg.to the right, sloping -26.6 deg. down.
- 16) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent spaced at 2-9-15 oc max. starting at 2-9-8 from the left end to 5-7-7 to connect truss(es) J02 (1 ply 2x4 DF), J04 (1 ply 2x4 DF) to back face of bottom chord.
- 17) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 5-7-7 from the left end to connect truss(es) J04 (1 ply 2x4 DF) to back face of top chord, skewed 45.0 deg.to the right, sloping -26.6 deg. down.
- 18) Fill all nail holes where hanger is in contact with lumber.
- 19) A minimum of (6) 8d x 1-1/2" nails are required into each member for SNP3 installation. All nailing is required in face of supported chords. For sloped applications, flanges may protrude above or below truss chords. Bending of extended flanges is permitted.
- 20) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-5=-74, 5-9=-74, 2-10=-16
 - Concentrated Loads (lb)
 - Vert: 4=-33(F=-16, B=-16) 15=-13(F=-6, B=-6)

Permit Number: 20-04898

Louws Truss, Inc., Ferndale, WA 98248

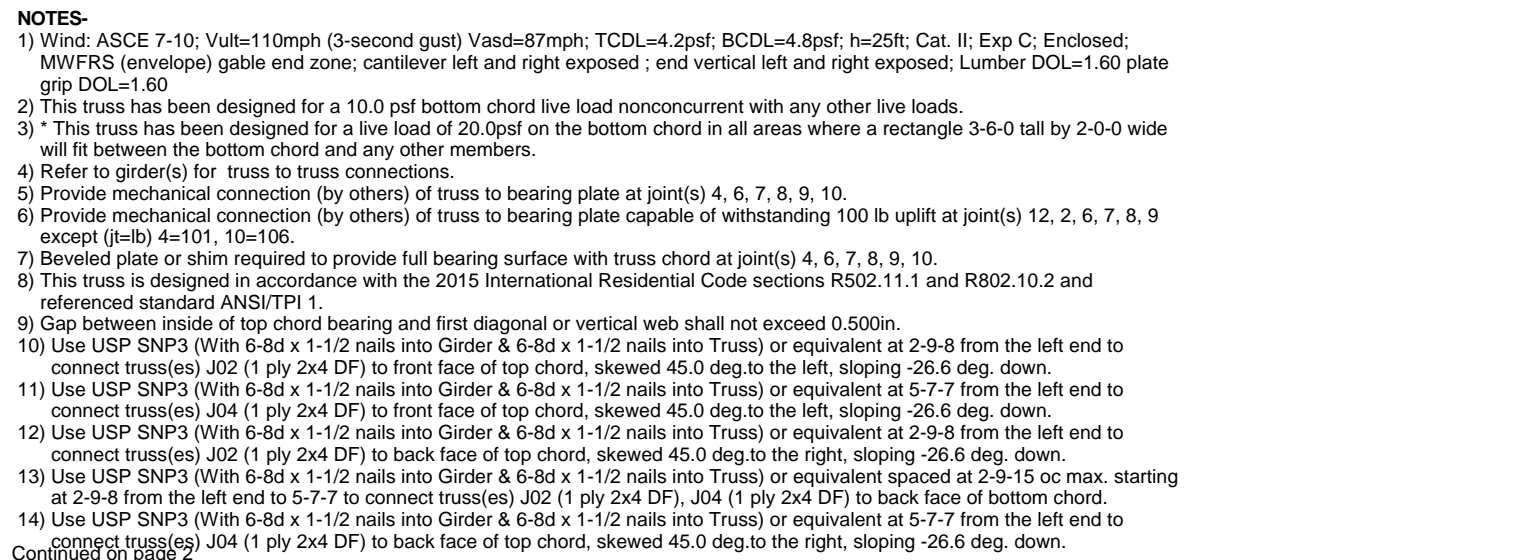

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	CJ02	Diagonal Hip Girder	1	1	Job Reference (optional)

- NOTES-**
- 15) Fill all nail holes where hanger is in contact with lumber.
 - 16) A minimum of (6) 8d x 1-1/2" nails are required into each member for SNP3 installation. All nailing is required in face of supported chords. For sloped applications, flanges may protrude above or below truss chords. Bending of extended flanges is permitted.
 - 17) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).



- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-4=-74, 4-11=-74, 2-12=-16
 - Concentrated Loads (lb)
 - Vert: 15=-33(F=-16, B=-16) 18=-19(F=-10, B=-10)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H02A	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:26 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyz1pO-j1Y7pJFJnQNeS9wXNyRULVSO6?gOpNNUeHw17zyz1ZZ

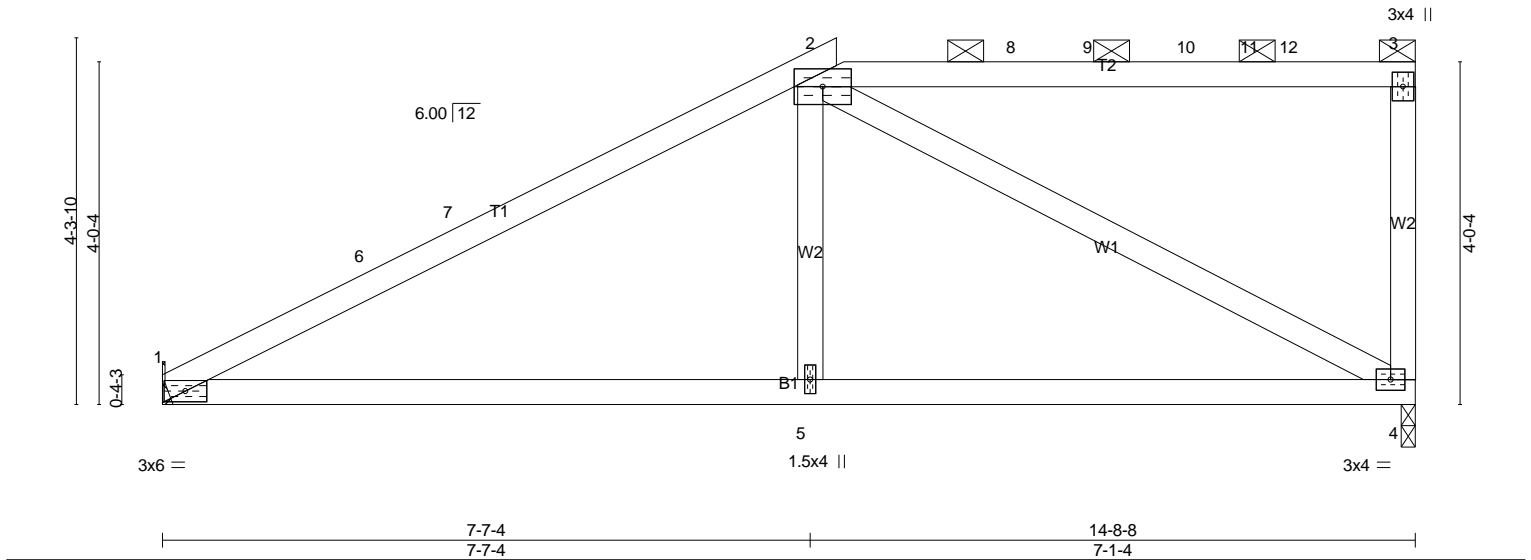

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.91	Vert(LL)	-0.13	1-5	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.64	Vert(CT)	-0.21	1-5	>834	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.74	Horz(CT)	0.01	4	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 61 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

(lb/size) 1=655/Mechanical, 4=632/0-2-0 (min. 0-1-8)
Max Horz 1=140(LC 11)
Max Uplift 1=126(LC 12), 4=153(LC 9)
Max Grav 1=661(LC 23), 4=632(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-6=-932/170, 6-7=-811/174, 2-7=-803/189
BOT CHORD 1-5=-260/716, 4-5=-262/710
WEBS 2-5=0/310, 2-4=-784/246

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-12 to 3-7-15, Interior(1) 3-7-15 to 7-8-9, Exterior(2) 7-8-9 to 12-9-11, Interior(1) 12-9-11 to 14-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=126, 4=153.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 110 lb down and 132 lb up at 7-8-10, 114 lb down and 88 lb up at 10-0-12, and 120 lb down and 93 lb up at 12-0-12, and 125 lb down and 150 lb up at 13-3-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)

Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Continued on page 2

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H02A	Roof Special	1	1	Job Reference (optional)

LOAD CASE(S) Standard
Uniform Loads (plf)
 Vert: 1-2=-74, 2-3=-74, 1-4=-16
Concentrated Loads (lb)
 Vert: 2=-10 12=28

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H02B	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:30 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-boeefhlpofu4wmElcoWQVLc6qc32IJ04YvuFGkyz1ZV

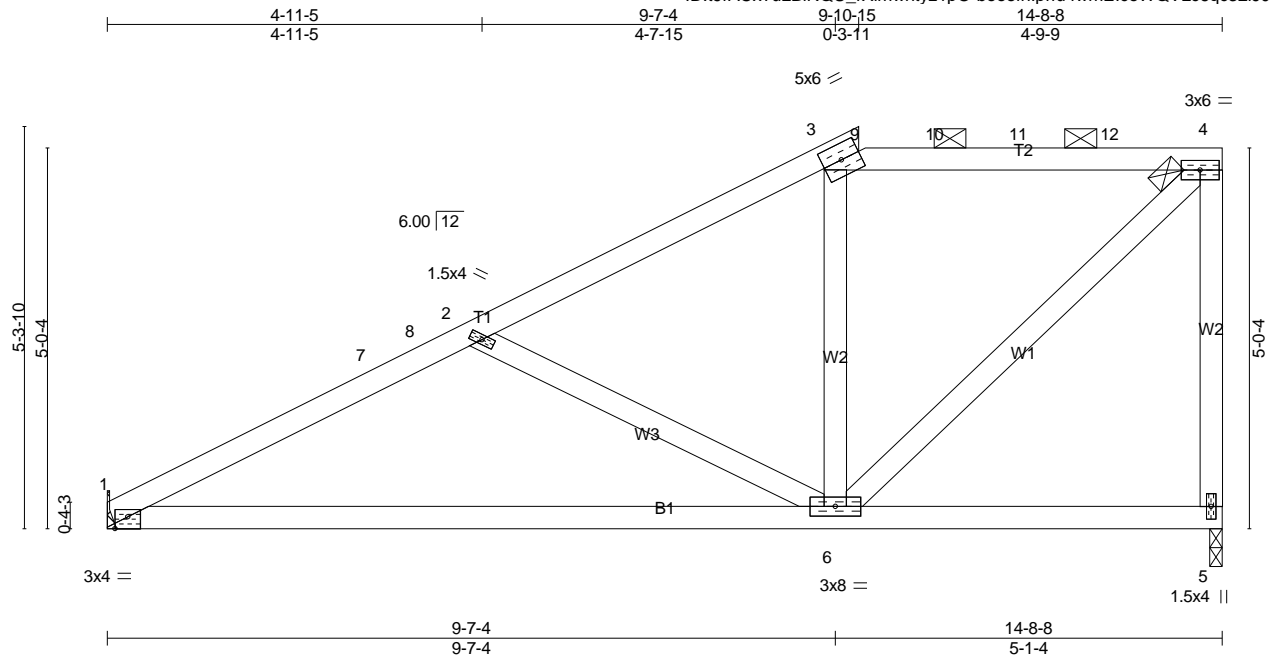

Scale = 1:30.4

Plate Offsets (X,Y)-- [1:0-2-0,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.80	Vert(LL)	-0.16	1-6	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.30	1-6	>572	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.19	Horz(CT)	0.01	5	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 70 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-4-14 oc purlins, except end verticals, and 2-0-0 oc purlins (5-0-0 max.): 3-4.
Rigid ceiling directly applied or 9-9-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=678/Mechanical, 5=914/0-2-0 (min. 0-1-8)
Max Horz 1=180(LC 11)
Max Uplift 1=130(LC 12), 5=263(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-7=-1087/256, 7-8=-960/263, 2-8=-960/264, 2-3=-692/183, 3-9=-541/186,
9-10=-541/186, 10-11=-542/186, 11-12=-542/186, 4-12=-542/186, 4-5=-893/333
BOT CHORD 1-6=-406/927
WEBS 2-6=-424/218, 4-6=-225/705

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-12 to 3-7-15, Interior(1) 3-7-15 to 9-4-11, Exterior(2) 9-4-11 to 14-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=130, 5=263.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 43 lb down and 110 lb up at 9-11-10, and 34 lb down and 84 lb up at 12-0-12, and 287 lb down and 246 lb up at 13-3-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

Continued on page 2

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H02B	Roof Special	1	1	Job Reference (optional)

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-74, 3-4=-74, 1-5=-16
Concentrated Loads (lb)
Vert: 12=-287

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	J05	Jack-Open Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:04 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-bLrVnJj8r6AF0?qrcx7OuW0xbJigijL4NC72Smyz1Yz

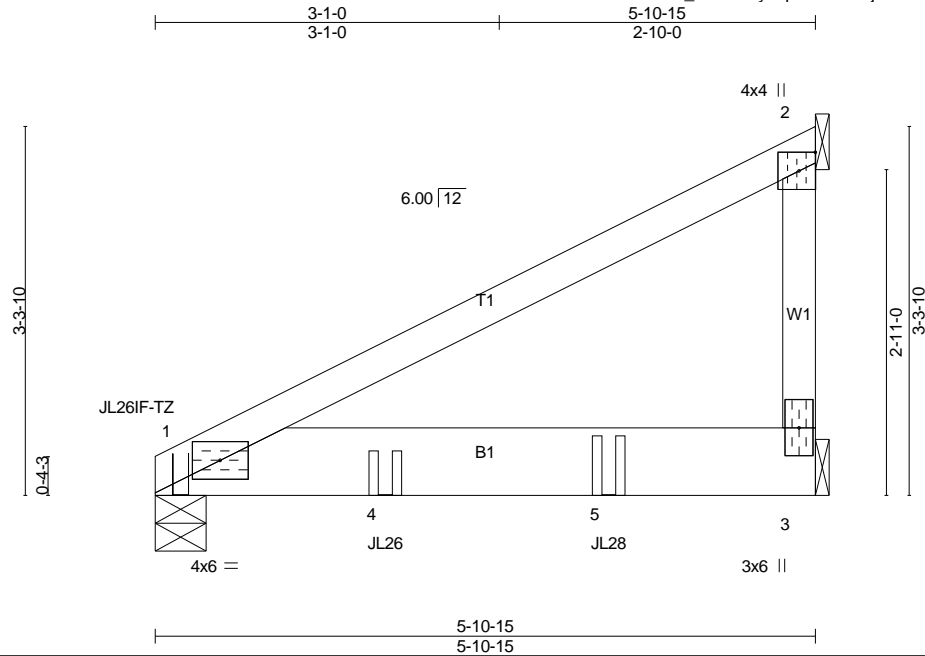

Scale = 1:20.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.71	Vert(LL)	-0.05	1-3	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.07	1-3	>956	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	2	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P							
									Weight: 29 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x8 DF SS
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-10-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=1422/0-5-8 (min. 0-1-8), 2=205/Mechanical, 3=647/Mechanical
Max Horz 1=103(LC 8)
Max Uplift1=-228(LC 8), 2=-106(LC 8), 3=-80(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 1=228, 2=106.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- 8) Use USP JL26IF-TZ (With 6-10d HDG nails into Girder & 4-10d x 1-1/2 HDG nails into Truss) or equivalent at 0-2-12 from the left end to connect truss(es) T01A (1 ply 2x4 DF) to back face of bottom chord.
- 9) Use USP JL26 (With 6-10d nails into Girder & 4-10d x 1-1/2 nails into Truss) or equivalent at 2-0-12 from the left end to connect truss(es) T01A (1 ply 2x4 DF) to back face of bottom chord.
- 10) Use USP JL28 (With 10-10d nails into Girder & 6-10d x 1-1/2 nails into Truss) or equivalent at 4-0-12 from the left end to connect truss(es) T01A (1 ply 2x4 DF) to back face of bottom chord.
- 11) Fill all nail holes where hanger is in contact with lumber.
- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-74, 1-3=-16
Concentrated Loads (lb)
Vert: 1=-598(B) 4=-589(B) 5=-589(B)

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	CJ01	Diagonal Hip Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:17 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-Emt2KjQ11DhQgY8Hqyil2y5kWAEP8ITKm2itCTyz1ae

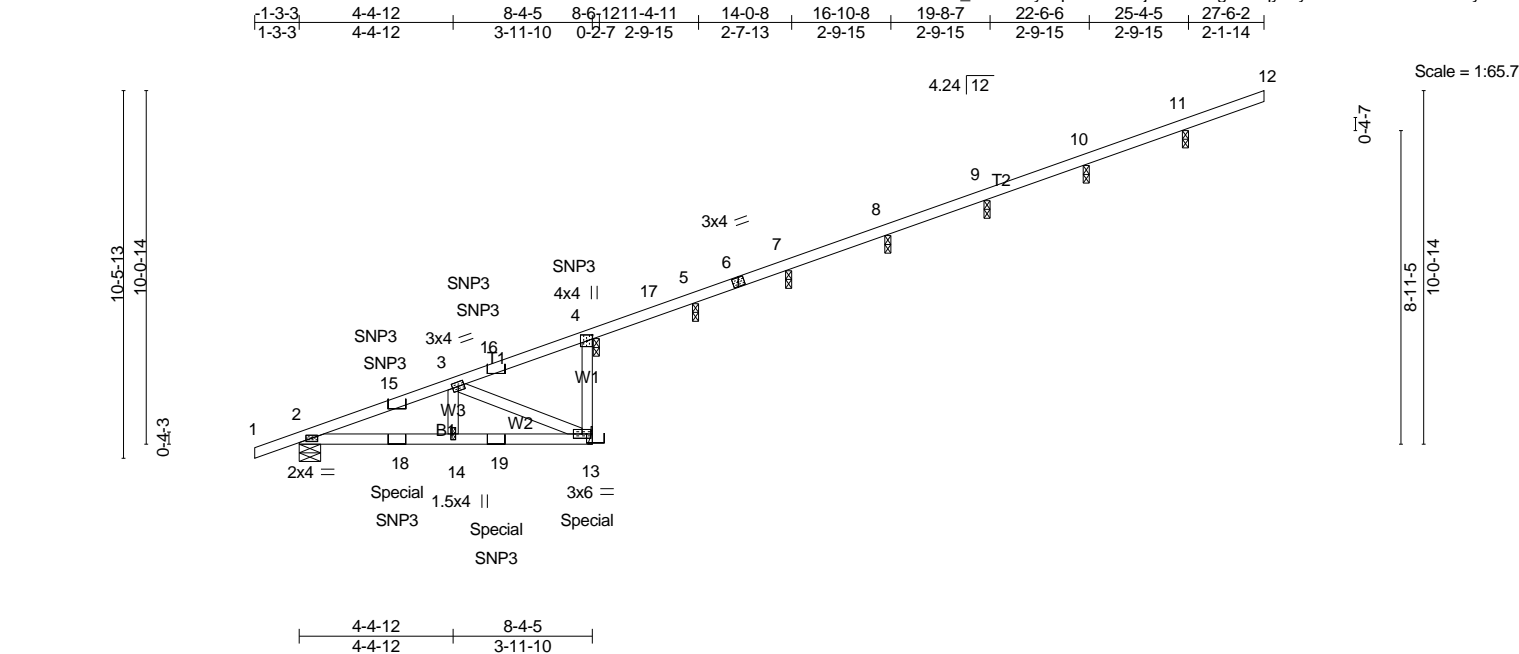


Plate Offsets (X,Y)-- [4:0-2-0,0-1-12]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	30.0	Plate Grip DOL	1.15	TC	0.40	Vert(LL)	-0.01 14 >999 240	MT20	220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	-0.02 13-14 >999 180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.15	Horz(CT)	0.01 13 n/a n/a		
BCDL	8.0	Code IRC2015/TPI2014		Matrix-P				Weight: 64 lb	FT = 0%

LUMBER-		BRACING-	
TOP CHORD 2x4 DF No.2		TOP CHORD	
BOT CHORD 2x4 DF No.2		BOT CHORD	
WEBS 2x4 DF No.2		Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
		Rigid ceiling directly applied or 10-0-0 oc bracing.	
		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.	

REACTIONS. All bearings 0-2-2 except (jt=length) 13=Mechanical, 2=0-7-6.

(lb) - Max Horz 2=277(LC 5)

Max Uplift All uplift 100 lb or less at joint(s) 2, 5, 7, 8, 9, 10 except 4=170(LC 5), 13=150(LC 8), 11=106(LC 5)

Max Grav All reactions 250 lb or less at joint(s) 5, 7, 8, 9, 10 except 4=336(LC 1), 13=891(LC 1), 2=499(LC 1), 11=336(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-15=-628/0, 3-15=-528/0

BOT CHORD 2-18=-172/535, 14-18=-172/535, 14-19=-172/535, 13-19=-172/535

WEBS 3-13=-580/204

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4, 5, 7, 8, 9, 10, 11.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5, 7, 8, 9, 10 except (jt=lb) 4=170, 13=150, 11=106.
 - 7) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 4, 5, 7, 8, 9, 10, 11.
 - 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 10) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 2-9-8 from the left end to connect truss(es) J02 (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
 - 11) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 5-7-7 from the left end to connect truss(es) J04 (1 ply 2x4 DF) to front face of top chord, skewed 45.0 deg.to the left, sloping -26.6 deg. down.
 - 12) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 2-9-8 from the left end to connect truss(es) J02 (1 ply 2x4 DF) to back face of top chord, skewed 45.0 deg.to the right, sloping -26.6 deg. down.
 - 13) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent spaced at 2-9-15 oc max. starting at 2-9-8 from the left end to 5-7-7 to connect truss(es) J02 (1 ply 2x4 DF), J04 (1 ply 2x4 DF) to back face of bottom chord.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	CJ01	Diagonal Hip Girder	1	1	Job Reference (optional)


- NOTES-**
- 14) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 5-7-7 from the left end to connect truss(es) J04 (1 ply 2x4 DF) to back face of top chord, skewed 45.0 deg.to the right, sloping -26.6 deg. down.
 - 15) Use USP SNP3 (With 6-8d x 1-1/2 nails into Girder & 6-8d x 1-1/2 nails into Truss) or equivalent at 8-5-6 from the left end to connect truss(es) J05 (1 ply 2x4 DF) to back face of top chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
 - 16) Fill all nail holes where hanger is in contact with lumber.
 - 17) A minimum of (6) 8d x 1-1/2" nails are required into each member for SNP3 installation. All nailing is required in face of supported chords. For sloped applications, flanges may protrude above or below truss chords. Bending of extended flanges is permitted.
 - 18) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 637 lb down and 89 lb up at 8-2-9 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 19) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-4=-74, 4-12=-74, 2-13=-16
 - Concentrated Loads (lb)
 - Vert: 4=-100(B) 13=-637(B) 16=-33(F=-16, B=-16) 19=-13(F=-6, B=-6)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T04	Roof Special Girder	1	1	Job Reference (optional)


Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:05:47 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyzt1pO-rdxlp0E7jB8gcc6dT0T7aIM1ePSI75PGO1pTnyzt1YI



5x6 =

Scale = 1:18.3

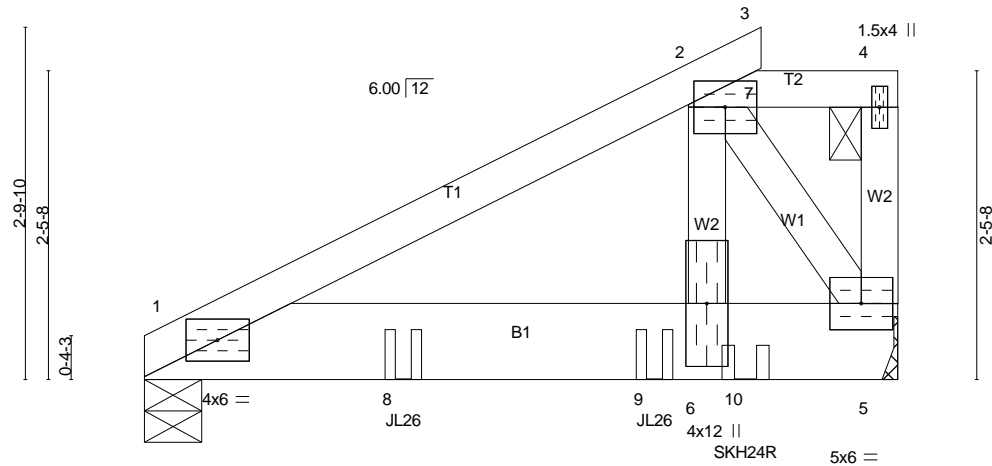

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.44	Vert(LL)	-0.02	1-6	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.31	Vert(CT)	-0.03	1-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.25	Horz(CT)	0.00	5	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-P							
									Weight: 34 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x8 DF SS
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-11 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=939/0-5-8 (min. 0-1-8), 5=1083/Mechanical
Max Horz 1=81(LC 5)
Max Uplift 1=200(LC 8), 5=269(LC 5)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-890/188
BOT CHORD 1-8=-187/746, 8-9=-187/746, 6-9=-187/746, 6-10=-181/713, 5-10=-181/713
WEBS 2-6=-229/1300, 2-5=-1362/323

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=200, 5=269.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP JL26 (With 6-10d nails into Girder & 4-10d x 1-1/2 nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 4-0-12 to connect truss(es) H02A (1 ply 2x4 DF), H02B (1 ply 2x4 DF) to front face of bottom chord.
- Use USP SKH24R (With 4-16d nails into Girder & 4-10d x 1-1/2 nails into Truss) or equivalent at 4-9-7 from the left end to connect truss(es) CJ02 (1 ply 2x4 DF) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 107 lb down and 95 lb up at 4-6-7 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	T04	Roof Special Girder	1	1	Job Reference (optional)

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-74, 2-3=-74, 2-7=-14, 4-7=-74, 1-5=-16
Concentrated Loads (lb)
Vert: 2=-23 8=-645(F) 9=-662(F) 10=-181(B)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE03	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:38 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-7of_kvqC5gKShnFJZtaDONTL4eNuZoPQbpHVRlyz1aJ

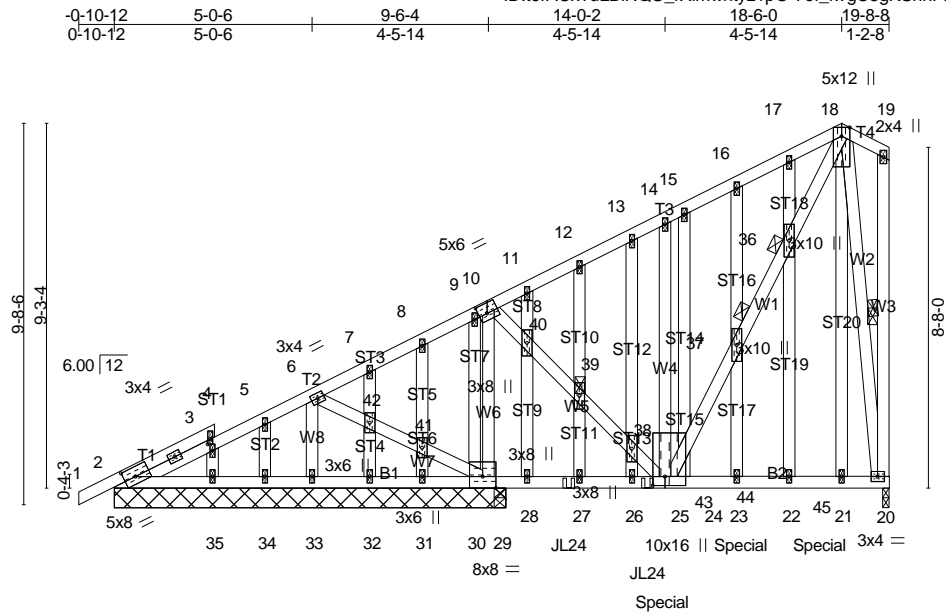


Plate Offsets (X,Y)-- [2:0-3-8,0-2-13], [3:0-1-9,0-0-12], [10:0-2-8,0-3-0], [24:0-0-0,0-1-12], [25:0-2-12,0-3-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.01	23	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.27	Vert(CT)	-0.02	23	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.17	Horz(CT)	-0.00	20	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 207 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 19-20, 18-20
JOINTS 1 Brace at Jt(s): 36, 37, 39

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 9-11-8 except (jt=length) 20=0-2-0, 29=0-3-8.
(lb) - Max Horz 2=332(LC 7)
Max Uplift All uplift 100 lb or less at joint(s) 33, 30, 31, 32, 34, 35, 2 except 20=156(LC 8), 29=175(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 33, 31, 32, 34, 35, 2 except 30=312(LC 1), 20=539(LC 1), 29=516(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 10-11=291/77, 11-12=304/88, 12-13=275/93, 13-14=251/94, 14-15=262/120, 15-16=290/147, 16-17=258/163
WEBS 10-30=359/98, 10-40=80/378, 39-40=100/439, 38-39=81/386, 25-38=77/358, 25-37=172/336, 36-37=157/308, 18-36=206/410, 18-20=503/160

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 20.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 33, 30, 31, 32, 34, 35, 2 except (jt=lb) 20=156, 29=175.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use USP JL24 (With 4-10d nails into Girder & 2-10d x 1-1/2 nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 11-6-12 from the left end to 13-6-12 to connect truss(es) J02A (1 ply 2x4 DF) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	GE03	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:38 2019 Page 2
ID:t9rACx?uLBINQU_rXimwnty1pO-7of_kv9C5gKShnFJZtaDONTL4eNuZoPQbpHVRlyz1aJ

- NOTES-**
- 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 55 lb down and 35 lb up at 13-11-4, and 55 lb down and 35 lb up at 15-11-4, and 55 lb down and 35 lb up at 17-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 14) No notches allowed in overhang and 0-10-12 from left end and 0-0-0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.
 - 15) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-18=-74, 2-20=-16, 18-19=-74

Concentrated Loads (lb)


Vert: 23=-55(B) 27=-55(B) 43=-55(B) 44=-55(B) 45=-55(B)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01	Roof Special Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:03:57 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-3SIAjPv7dWkTiCzAMQggOIXYIs5WEvDzGO?c9yz1a0



Scale = 1:36.1

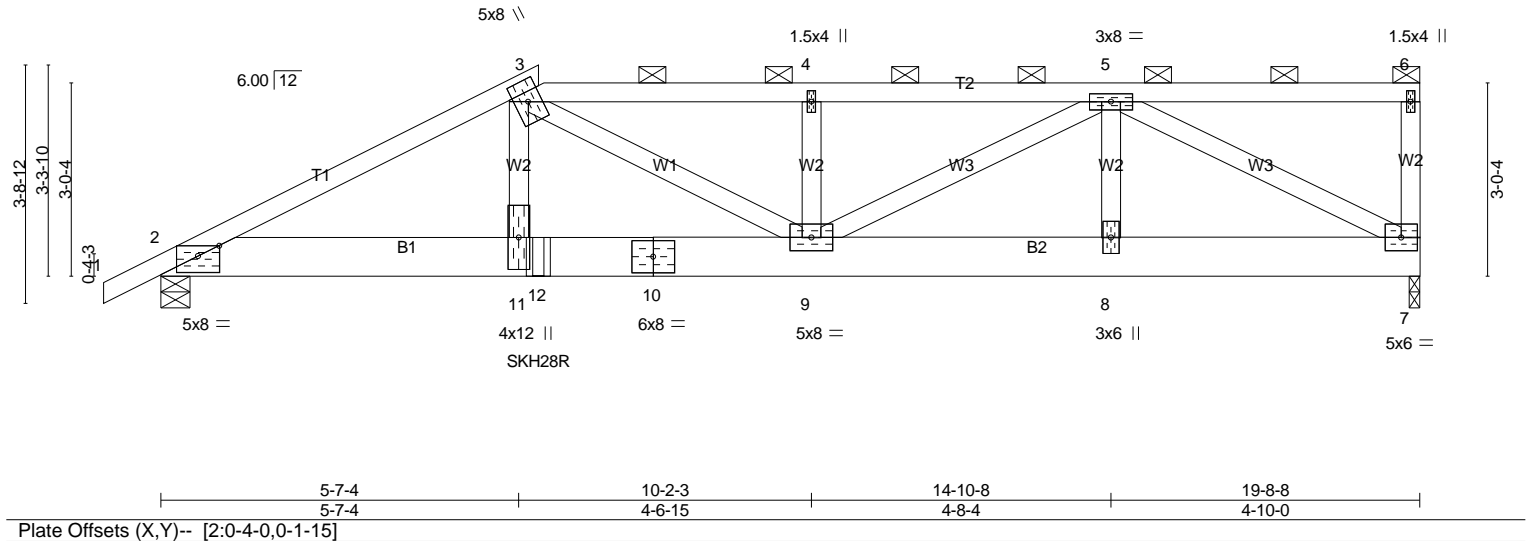


Plate Offsets (X,Y)-- [2:0-4-0,0-1-15]		5-7-4 5-7-4		10-2-3 4-6-15		14-10-8 4-8-4		19-8-8 4-10-0	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.10 9-11	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.29	Vert(CT)	-0.15 9-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.82	Horz(CT)	0.02 7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
Weight: 116 lb									FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x8 DF SS
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 3-1-14 oc purlins, except end verticals, and 2-0-0 oc purlins (3-6-10 max.): 3-6. Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=1159/0-2-0 (min. 0-1-8), 2=1659/0-5-8 (min. 0-1-12)
Max Horz 2=105(LC 26)
Max Uplift 7=259(LC 5), 2=329(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3076/651, 3-4=-2677/596, 4-5=-2669/591
BOT CHORD 2-11=-635/2661, 11-12=-630/2623, 10-12=-630/2623, 9-10=-630/2623, 8-9=-417/1768, 7-8=-417/1768
WEBS 3-11=-120/937, 3-9=-372/413, 4-9=-448/158, 5-9=-243/1028, 5-7=-1974/439

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=259, 2=329.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP SKH28R (With 10-16d nails into Girder & 8-10d x 1-1/2 nails into Truss) or equivalent at 5-10-15 from the left end to connect truss(es) CJ01 (1 ply 2x4 DF) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 226 lb down and 191 lb up at 5-8-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

Continued on page 2

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01	Roof Special Girder	1	1	Job Reference (optional)

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-74, 3-6=-74, 2-7=-16
Concentrated Loads (lb)
Vert: 3=-126 12=-868(B)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01A	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:01 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyZ1pO-yDXhZmydglEBYJWkPCUcqEv6lw8VSBCouuMckwyZ1Zy

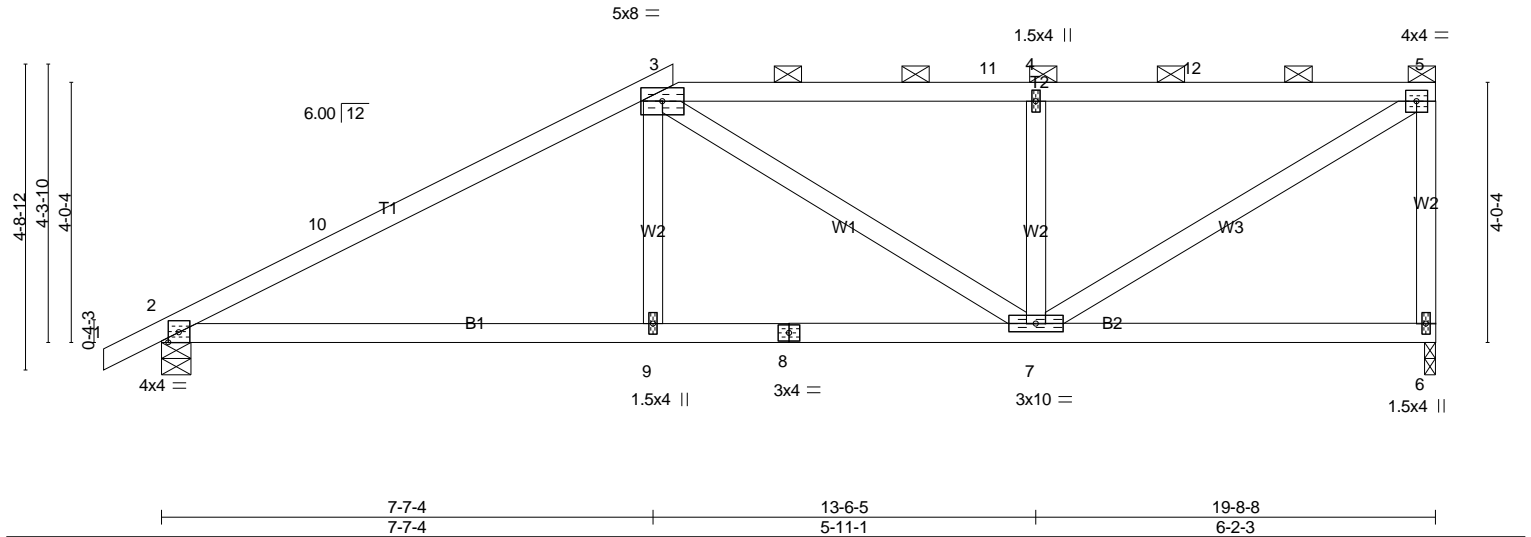

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.98	Vert(LL) -0.11	2-9	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.64	Vert(CT) -0.20	2-9	>999	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.23	Horz(CT) 0.02	6	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014							
							Weight: 89 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-5-7 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 6=869/0-2-0 (min. 0-1-8), 2=958/0-5-8 (min. 0-1-8)
Max Horz 2=147(LC 9)
Max Uplift 6=180(LC 9), 2=156(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-1372/217, 3-10=-1241/237, 3-11=-1044/249, 4-11=-1046/248, 4-12=-1039/245,
5-12=-1039/245, 5-6=-818/211
BOT CHORD 2-9=-320/1101, 8-9=-321/1096, 7-8=-321/1096
WEBS 3-9=0/267, 3-7=-303/92, 4-7=-535/202, 5-7=-255/1184

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 7-8-9, Exterior(2) 7-8-9 to 12-9-11, Interior(1) 12-9-11 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=180, 2=156.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 103 lb down and 127 lb up at 7-8-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-74, 3-5=-74, 2-6=-16

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01A	Roof Special	1	1	Job Reference (optional)

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-3

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01B	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:04 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyzt1pO-MoDpBo_WzgcmpnEJ5K2JSsXme7B_fQQFasatLFyz1Zv

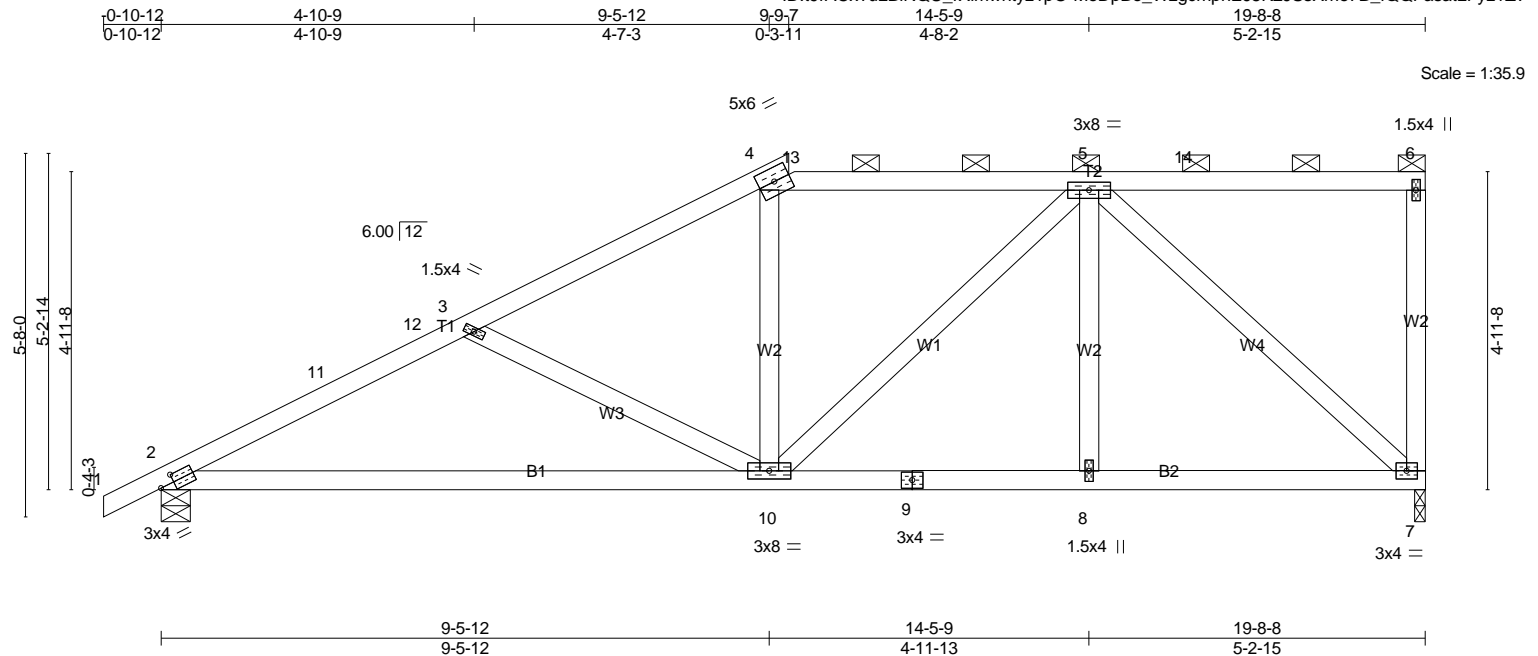


Plate Offsets (X,Y)-- [2:0-2-10,0-1-8]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	30.0	Plate Grip DOL	1.15	TC	0.40	in (loc)	l/defl	L/d	GRIP
TCDL	7.0	Lumber DOL	1.15	BC	0.53	Vert(LL)	-0.15 2-10	>999	220/195
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.71	Vert(CT)	-0.28 2-10	>824	
BCDL	8.0	Code IRC2015/TPI2014		Matrix-SH		Horz(CT)	0.03 7	n/a	
								Weight: 99 lb FT = 0%	

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-10-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
Rigid ceiling directly applied or 9-3-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=185(LC 11)
Max Uplift 7=178(LC 9), 2=193(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-11=-1474/298, 11-12=-1403/306, 3-12=-1349/314, 3-4=-1108/223, 4-13=-923/230, 5-13=-923/230
BOT CHORD 2-10=-450/1259, 9-10=-223/745, 8-9=-223/745, 7-8=-223/745
WEBS 3-10=-384/189, 5-7=-990/239

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 9-3-3, Exterior(2) 9-3-3 to 14-5-9, Interior(1) 14-5-9 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=178, 2=193.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 46 lb down and 115 lb up at 9-10-2 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-74, 4-6=-74, 2-7=-16

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01C	Roof Special	1	1	Job Reference (optional)


Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:08 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyZ1pO-EaTK19101u6BIOY4KA6GciiRjkaEbFLqVUY4U0yz1Zr

0-10-12	5-10-9	11-5-12	11-9-7	15-3-13	19-8-8
0-10-12	5-10-9	5-7-3	0-3-11	3-6-6	4-4-11

5x6 ≍

Scale = 1:39.4

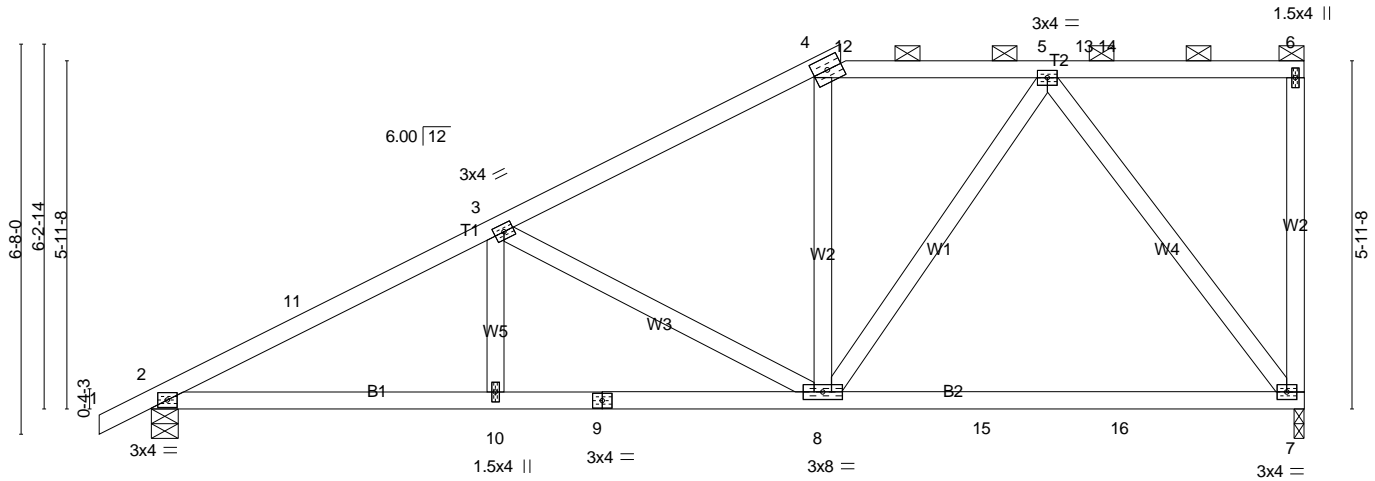

5-10-9	11-5-12	19-8-8
5-10-9	5-7-3	8-2-12

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL 1.15	2-0-0	TC 0.39	Vert(LL) -0.11	7-8	>999	240		MT20	220/195
TCDL 7.0	Lumber DOL 1.15		BC 0.45	Vert(CT) -0.20	7-8	>999	180			
BCLL 0.0 *	Rep Stress Incr YES		WB 0.65	Horz(CT) 0.03	7	n/a	n/a			
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 102 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-11 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 9-6-2 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=223(LC 11)
Max Uplift 7=174(LC 9), 2=192(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-11=-1494/264, 3-11=-1407/276, 3-4=-927/200, 4-12=-740/210, 5-12=-741/210
BOT CHORD 2-10=-429/1245, 9-10=-429/1245, 8-9=-429/1245, 8-15=-205/517, 15-16=-205/517, 7-16=-205/517
WEBS 3-8=-574/209, 5-8=-97/398, 5-7=-843/258

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 11-3-3, Exterior(2) 11-3-3 to 16-4-5, Interior(1) 16-4-5 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=174, 2=192.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 50 lb down and 117 lb up at 11-10-2 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-74, 4-6=-74, 2-7=-16


Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01D	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248 8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:11 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyZ1pO-f98SfB4vKpVm9sHf?lgzELKvnybkocRHBSnk5Lyz1Z0

0-10-12	6-10-9	13-5-12	13-9-7	19-8-8
0-10-12	6-10-9	6-7-3	0-3-11	5-11-1

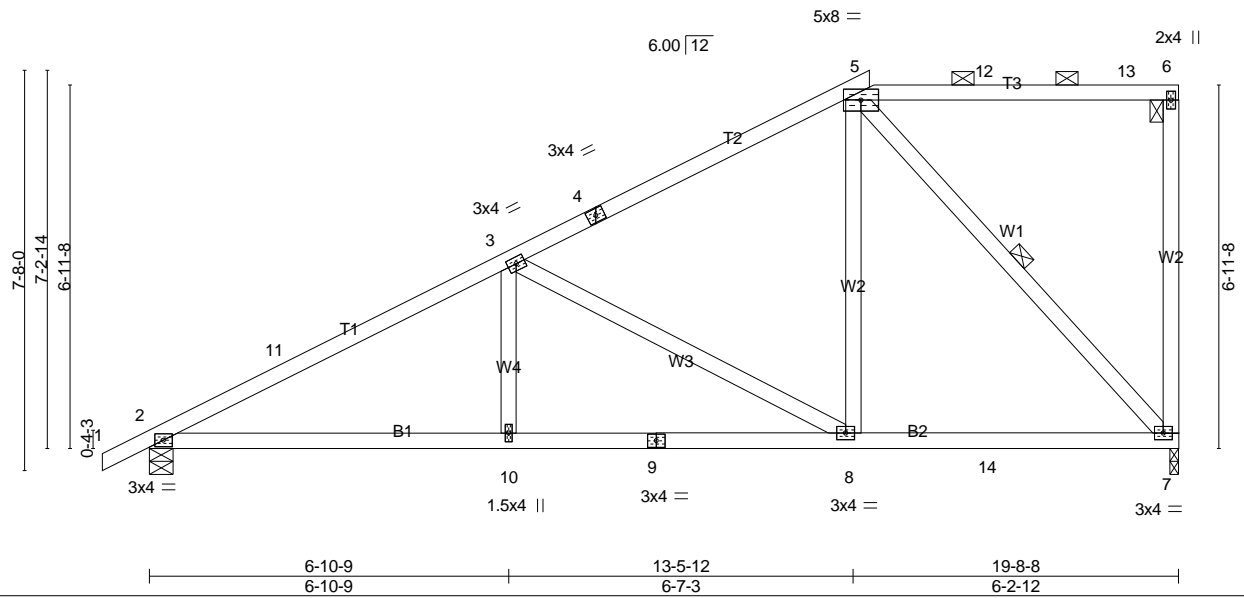

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.60	Vert(LL) -0.06	2-10	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.46	Vert(CT) -0.12	2-10	>999	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.63	Horz(CT) 0.03	7	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014						Weight: 101 lb	FT = 0%

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.2	TOP CHORD Structural wood sheathing directly applied or 4-6-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x4 DF No.2	BOT CHORD Rigid ceiling directly applied or 9-9-9 oc bracing.
WEBS 2x4 DF No.2	WEBS 1 Row at midpt 5-7
	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=259(LC 11)
Max Uplift 7=164(LC 9), 2=178(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-11=-1454/221, 3-11=-1354/237, 3-4=-748/158, 4-5=-625/181
BOT CHORD 2-10=-407/1200, 9-10=-407/1200, 8-9=-407/1200, 8-14=-230/552, 7-14=-230/552
WEBS 3-10=0/255, 3-8=-740/252, 5-8=-56/457, 5-7=-816/250

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 13-7-1, Exterior(2) 13-7-1 to 18-8-3, Interior(1) 18-8-3 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=164, 2=178.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 100 lb down and 118 lb up at 13-7-1 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-74, 5-6=-74, 2-7=-16

Louws Truss, Inc., Ferndale, WA 98248

5x8 = Scale: 1/4"=1'

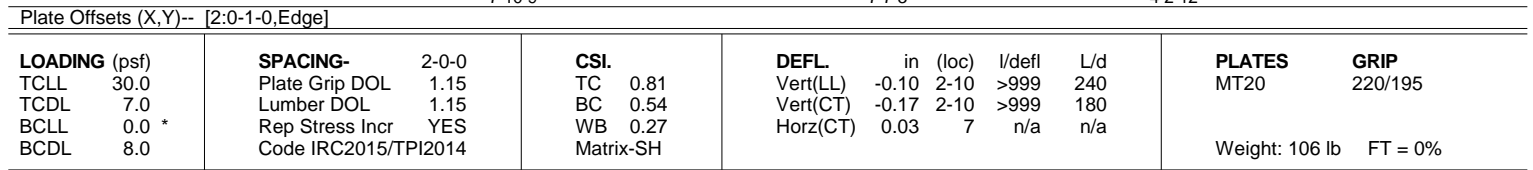

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=297(LC 9)
Max Uplift 7=-160(LC 12), 2=-178(LC 12)

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 15-7-1, Exterior(2) 15-7-1 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=160, 2=178.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 47 lb down and 98 lb up at 15-7-1 on top chord. The design/selection of such connection device(s) is the responsibility of others.

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01F	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:18 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-yV367a9lgzNnUwJ?vGlc0p79xmz1xrwJo2zcrRyz1Zh

-0-10-12 6-1-4 11-7-15 17-5-12 17-9-719-8-8
0-10-12 6-1-4 5-6-12 5-9-13 0-3-111-11-1

Scale = 1:52.5

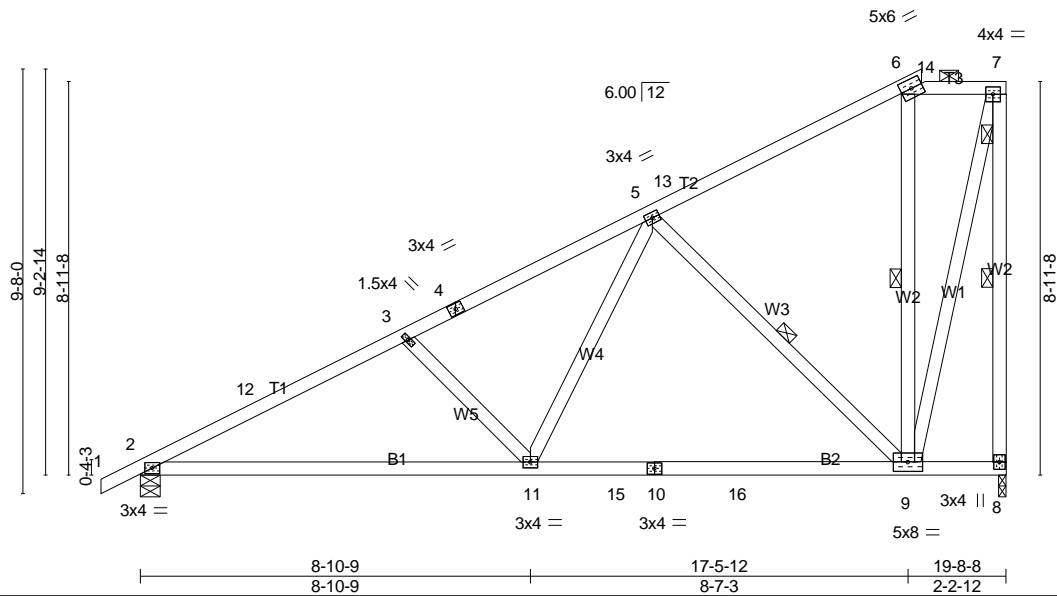

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.41	Vert(LL) -0.12	9-11	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.54	Vert(CT) -0.20	2-11	>999	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.32	Horz(CT) 0.02	8	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014							
							Weight: 117 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 7-8, 5-9, 6-9

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 8=983/0-2-0 (min. 0-1-8), 2=967/0-5-8 (min. 0-1-8)
Max Horz 2=337(LC 11)
Max Uplift 8=245(LC 12), 2=181(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-12=-1471/246, 3-12=-1384/258, 3-4=-1162/204, 4-5=-994/223, 5-13=-371/138,
6-13=-358/159, 7-8=-987/262
BOT CHORD 2-11=-409/1225, 11-15=-300/744, 10-15=-300/744, 10-16=-300/744, 9-16=-300/744
WEBS 3-11=-391/200, 5-11=-68/495, 5-9=-735/264, 6-9=-282/220, 7-9=-265/927

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 17-3-3, Exterior(2) 17-3-3 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=245, 2=181.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 178 lb down and 178 lb up at 17-10-2 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-74, 6-7=-74, 2-8=-16

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H01F	Roof Special	1	1	Job Reference (optional)


Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:18 2019 Page 2
ID:t9rACx?uLBINQU_rXimwnty1pO-yV367a9lgzNnUwJ?vGlc0p79xmz1xrwJo2zcrRyz1Zh

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 14=-127

Louws Truss, Inc., Ferndale, WA 98248

Scale = 1:25.8



LUMBER-	
TOP CHORD	2x4 DF No.2
BOT CHORD	2x4 DF No.2
WEBS	2x4 DF No.2
BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 3-9-12 oc purlins, except end verticals, and 2-0-0 oc purlins (3-6-12 max.): 2-4.
BOT CHORD	Rigid ceiling directly applied or 9-7-4 oc bracing.

REACTIONS. (lb/size) 1=987/0-5-8 (min. 0-1-8), 5=1243/0-2-0 (min. 0-1-8)
 Max Horz 1=102(LC 26)
 Max Uplift 1=-261(LC 8), 5=-398(LC 8)
 Max Grav 1=1006(LC 19), 5=1266(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1799/476, 2-8=-1544/504, 3-8=-1555/507, 3-9=-1546/503, 9-10=-1546/503,
4-10=-1546/503, 4-5=-1193/432
BOT CHORD 1-7=-424/1505, 7-11=-424/1490, 11-12=-424/1490, 6-12=-424/1490
WEBS 2-7=-26/418, 3-6=-793/424, 4-6=-532/1731

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=261, 5=398.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Use USP JL24 (With 4-10d nails into Girder & 2-10d x 1-1/2 nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 8-0-12 from the left end to 13-3-4 to connect truss(es) J06A (1 ply 2x4 DF), J06B (1 ply 2x4 DF), J06C (1 ply 2x4 DF), J06D (1 ply 2x4 DF) to front face of bottom chord.
- 11) Fill all nail holes where hanger is in contact with lumber.
- 12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 124 lb down and 109 lb up at 5-8-10, 247 lb down and 152 lb up at 8-0-12, 254 lb down and 156 lb up at 10-0-12, and 254 lb down and 156 lb up at 12-0-12, and 254 lb down and 157 lb up at 13-3-4 on top chord, and 261 lb down and 75 lb up at 5-10-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H02	Roof Special Girder	1	1	Job Reference (optional)

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-74, 2-4=-74, 1-5=-16
Concentrated Loads (lb)
Vert: 2=-24 3=-134 6=-30(F) 8=-134 9=-134 10=-134 11=-261(F) 12=-30(F) 13=-30(F) 14=-30(F)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03	Roof Special Girder	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:34 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyz1pO-Ua19U2LKvuOVPOX4rdaMgBnsyDTMhzOfTxsSPWyZ1ZR

0-10-12	5-7-4	5-10-15	10-2-3	14-10-8	19-8-8
0-10-12	5-7-4	0-3-11	4-3-4	4-8-4	4-10-0

Scale = 1:36.1

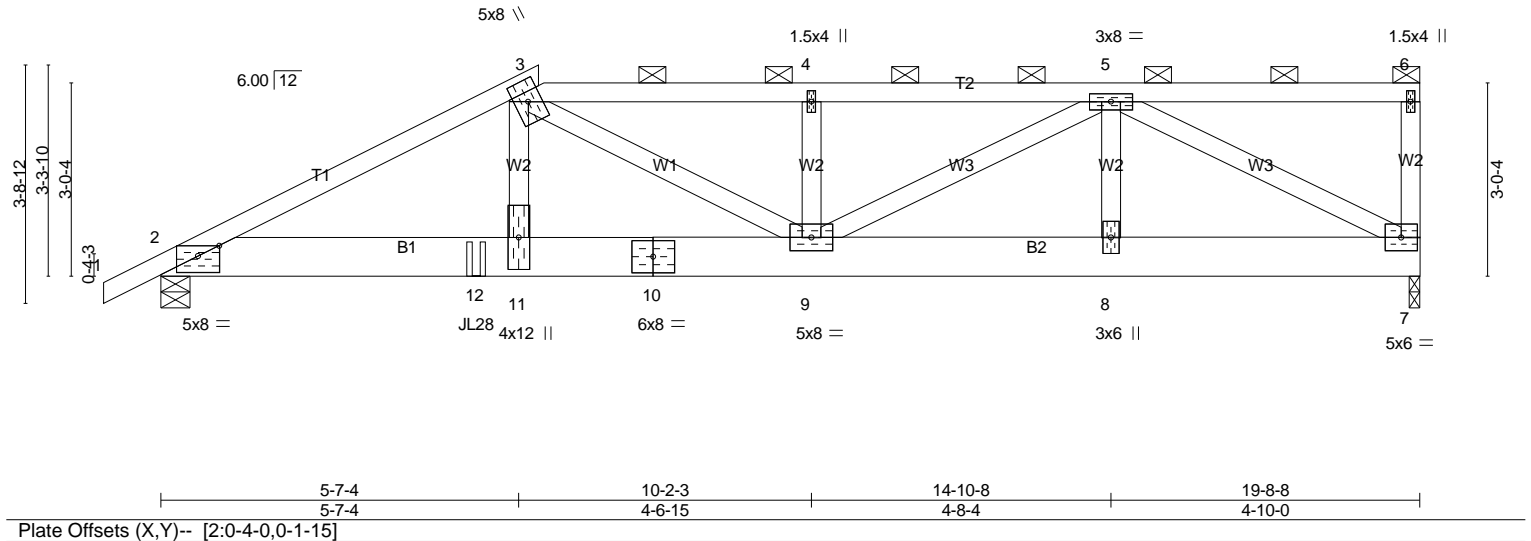


Plate Offsets (X,Y)-- [2:0-4-0,0-1-15]		5-7-4		10-2-3		14-10-8		19-8-8	
		5-7-4		4-6-15		4-8-4		4-10-0	

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.54	Vert(LL)	-0.09	9	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.14	9	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.80	Horz(CT)	0.02	7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 116 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x8 DF SS
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-15 oc purlins, except end verticals, and 2-0-0 oc purlins (3-8-6 max.): 3-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=1130/0-2-0 (min. 0-1-8), 2=1770/0-5-8 (min. 0-1-14)
Max Horz 2=105(LC 7)
Max Uplift 7=-256(LC 5), 2=-365(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3110/682, 3-4=-2540/578, 4-5=-2532/573
BOT CHORD 2-12=-663/2693, 11-12=-663/2693, 10-11=-654/2646, 9-10=-654/2646, 8-9=-414/1724, 7-8=-414/1724
WEBS 3-11=-238/1159, 3-9=-551/432, 4-9=-443/157, 5-9=-226/922, 5-7=-1923/435

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=256, 2=365.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP JL28 (With 10-10d nails into Girder & 6-10d x 1-1/2 nails into Truss) or equivalent at 4-11-4 from the left end to connect truss(es) T04 (1 ply 2x8 DF) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 88 lb down and 82 lb up at 5-8-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

Continued on page 2

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03	Roof Special Girder	1	1	Job Reference (optional)


LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-74, 3-6=-74, 2-7=-16
Concentrated Loads (lb)
Vert: 3=-10 12=-1067(F)

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03A	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:37 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-u9jl74ODCpm4GrGfWm83HqPGDQQxuT669V460qyz1ZO

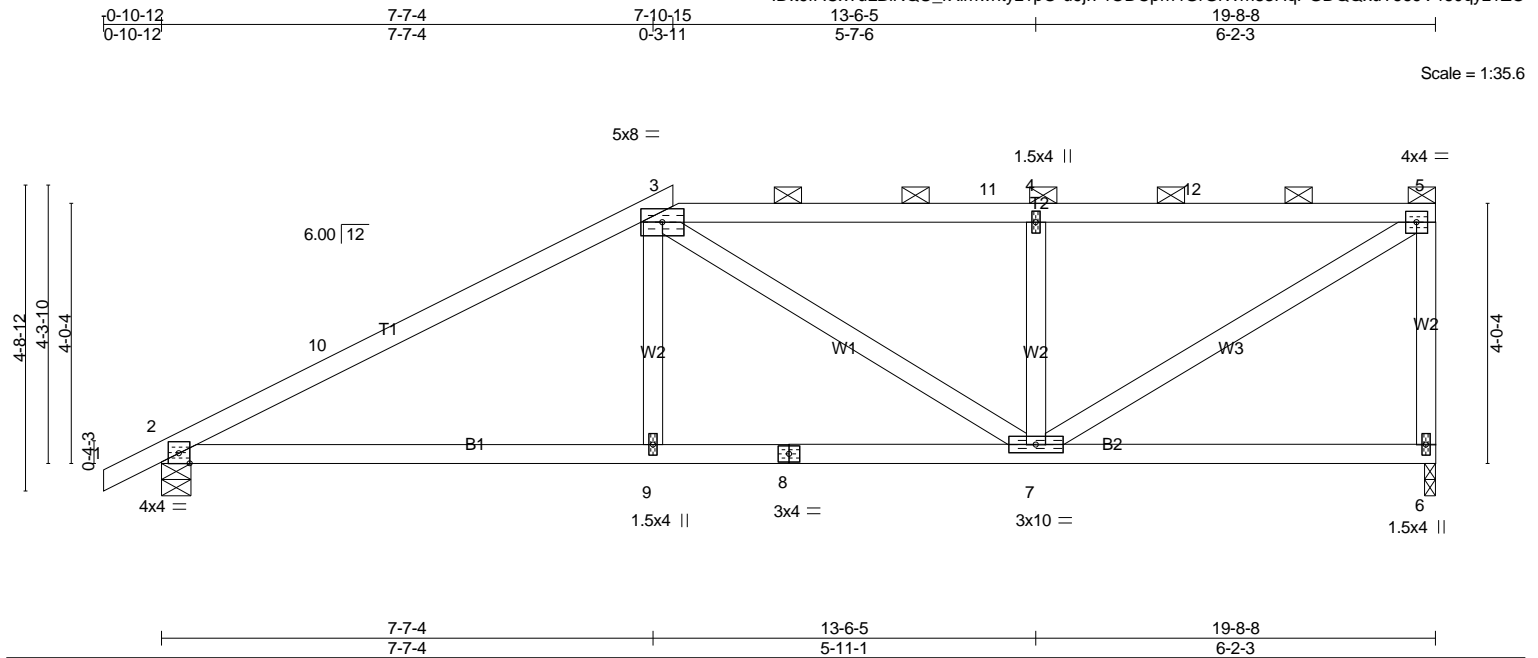

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	30.0	Plate Grip DOL	1.15	TC	0.98	Vert(LL)	-0.11	in (loc)	2-9	L/d	240	MT20	220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-0.20	2-9	>999	180			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.02	6	n/a	n/a			
BCDL	8.0	Code IRC2015/TPI2014		Matrix-SH									
												Weight: 89 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-5-8 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 6=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=147(LC 9)
Max Uplift 6=179(LC 9), 2=155(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-1368/217, 3-10=-1237/237, 3-11=-1042/249, 4-11=-1044/248, 4-12=-1037/245,
5-12=-1037/245, 5-6=-817/211
BOT CHORD 2-9=-320/1097, 8-9=-321/1093, 7-8=-321/1093
WEBS 3-9=0/267, 3-7=-301/94, 4-7=-534/201, 5-7=-255/1182

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 7-8-9, Exterior(2) 7-8-9 to 12-9-11, Interior(1) 12-9-11 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=179, 2=155.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 100 lb down and 125 lb up at 7-8-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-74, 3-5=-74, 2-6=-16

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03B	Roof Special	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

ID:t9rACx?uLBINQU_rXimwntyz1pO-nwyoyRRjF1GWITZQlbC?SgZ4R2pSqAkh472K9cyz1ZK
8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:41 2019 Page 1

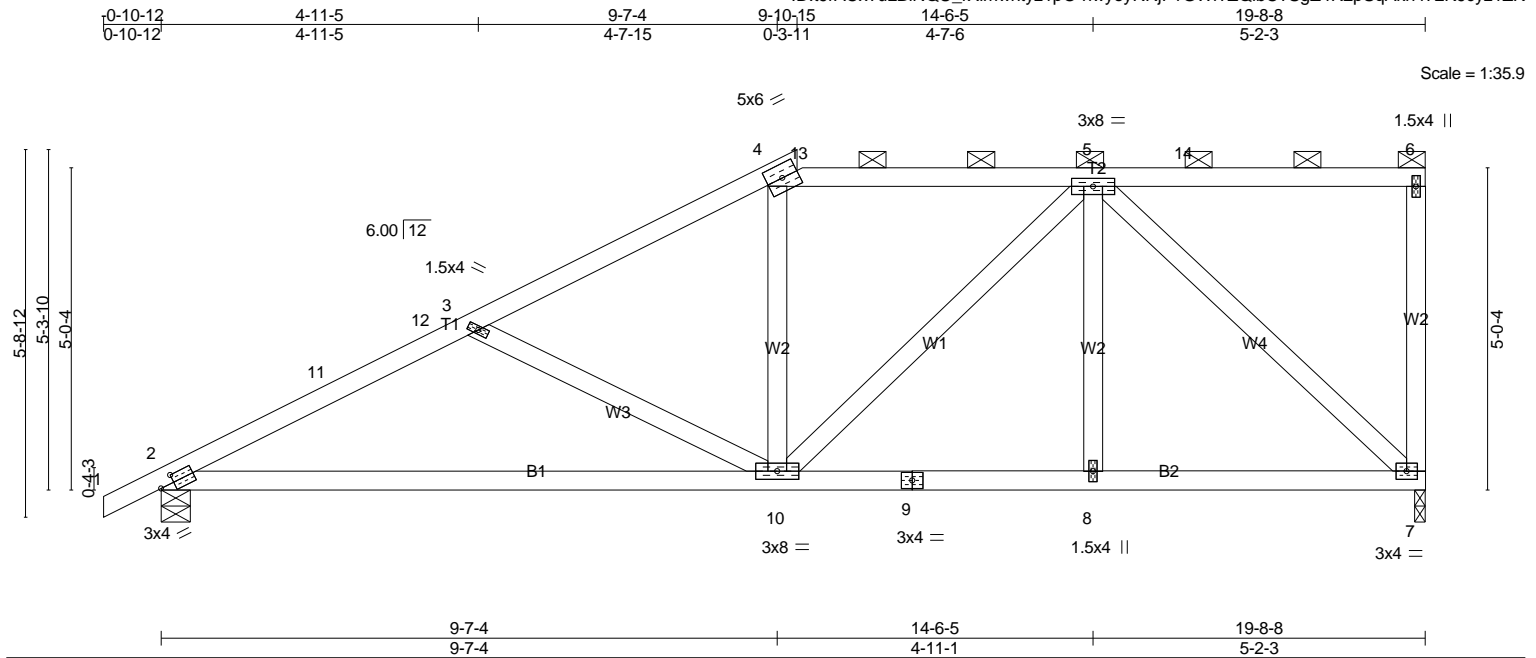


Plate Offsets (X,Y)-- [2:0-2-10,0-1-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.39	Vert(LL)	-0.16 2-10	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.54	Vert(CT)	-0.30 2-10	>785	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.03 7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
								Weight: 100 lb FT = 0%	

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-9-14 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
Rigid ceiling directly applied or 9-2-14 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
Max Horz 2=187(LC 9)
Max Uplift 7=178(LC 9), 2=194(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-11=-1471/299, 11-12=-1400/313, 3-12=-1344/315, 3-4=-1098/221, 4-13=-912/229,
5-13=-913/229
BOT CHORD 2-10=-451/1256, 9-10=-221/728, 8-9=-221/728, 7-8=-221/728
WEBS 3-10=-392/193, 5-10=-85/256, 5-7=-980/239

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 9-4-11, Exterior(2) 9-4-11 to 14-6-5, Interior(1) 14-6-5 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=178, 2=194.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 50 lb down and 117 lb up at 9-11-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-74, 4-6=-74, 2-7=-16

Continued on page 2

Permit Number: 20-04898


Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03B	Roof Special	1	1	Job Reference (optional)

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 13=-0

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03C	California	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:44 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyZ1pO-BVexbTTcYy4cwl?Rkmi4IBbUFtp1YX7m4H_lwyz1ZH

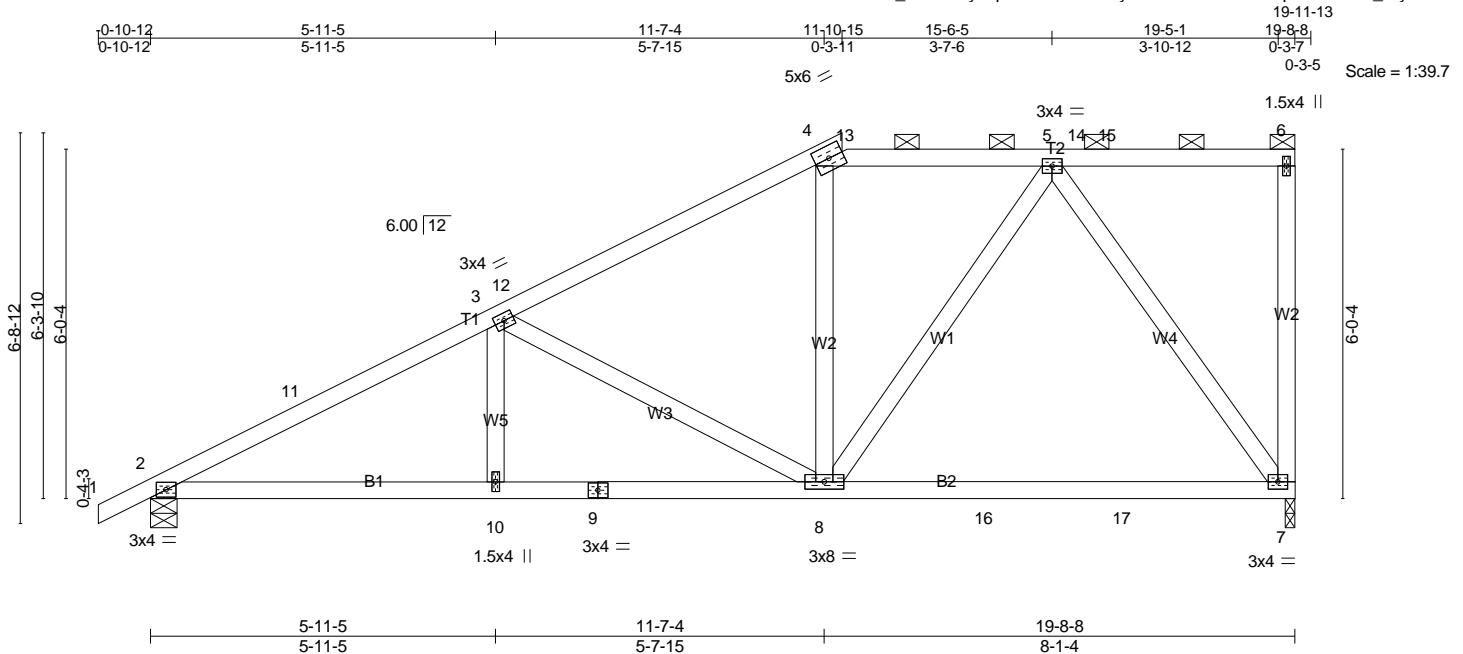

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.40	Vert(LL)	-0.11	7-8	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.44	Vert(CT)	-0.19	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.63	Horz(CT)	0.03	7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 102 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 9-7-1 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=956/0-5-8 (min. 0-1-8), 7=868/0-2-0 (min. 0-1-8)
Max Horz 2=225(LC 11)
Max Uplift 2=192(LC 12), 7=173(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-11=-1492/264, 3-11=-1404/276, 3-12=-916/178, 4-12=-904/199, 4-13=-729/210, 5-13=-729/210

BOT CHORD 2-10=-423/1242, 9-10=-423/1242, 8-9=-423/1242, 8-16=-198/493, 16-17=-198/493, 7-17=-198/493

WEBS 3-8=-583/210, 5-8=-103/418, 5-7=-837/257

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 11-4-11, Exterior(2) 11-4-11 to 16-5-13, Interior(1) 16-5-13 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=192, 7=173.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 36 lb down and 97 lb up at 11-11-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard


- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-74, 4-6=-74, 2-7=-16

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03D	California	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Thu Jul 11 18:04:48 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-3GtSQrW6cB9W5XcmgaqeE8MEIsDBzKXjhiFCuiyz1ZD

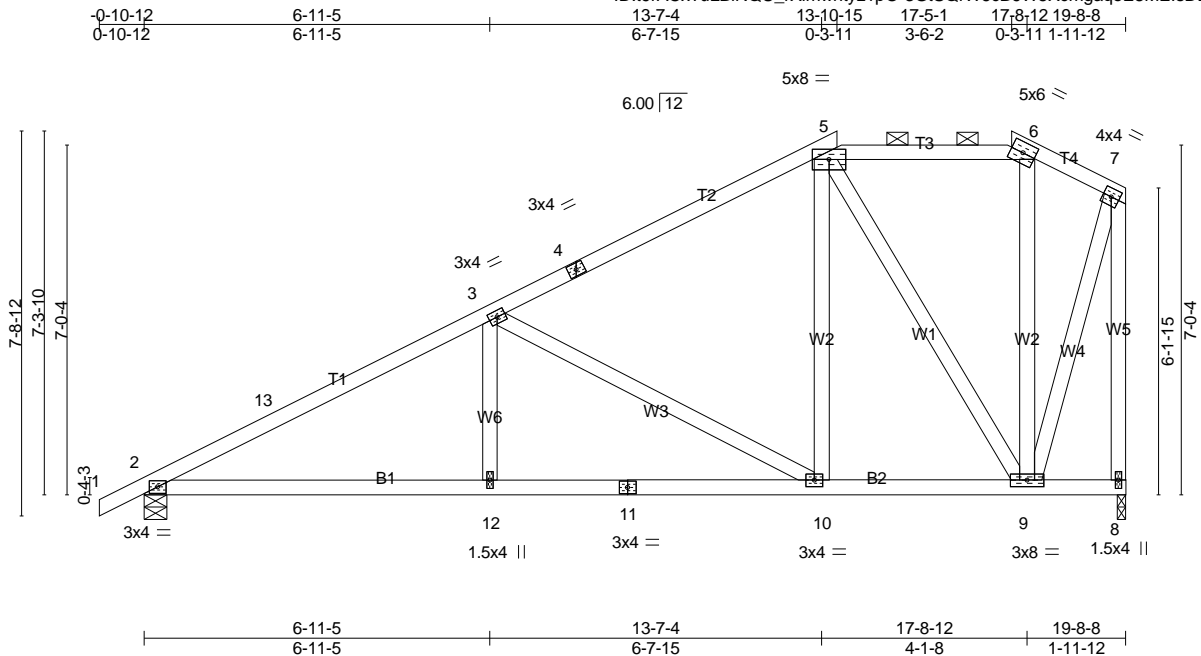

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.61	Vert(LL) -0.07	2-12	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL 1.15	BC 0.47	Vert(CT) -0.12	2-12	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.03	8	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014	Matrix-SH						
							Weight: 117 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-5-1 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 9-9-9 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=994/0-5-8 (min. 0-1-8), 8=956/0-2-0 (min. 0-1-8)
Max Horz 2=240(LC 34)
Max Uplift 2=195(LC 12), 8=171(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-13=-1537/256, 3-13=-1437/273, 3-4=-816/186, 4-5=-689/209, 6-7=-289/172, 7-8=-935/240

BOT CHORD 2-12=-407/1273, 11-12=-407/1273, 10-11=-407/1273, 9-10=-231/610
WEBS 3-12=0/267, 3-10=-749/254, 5-10=-59/436, 5-9=-738/215, 7-9=-234/810

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 13-8-9, Exterior(2) 13-8-9 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=195, 8=171.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 227 lb down and 179 lb up at 13-8-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-74, 5-6=-74, 6-7=-74, 2-8=-16

Continued on page 2


Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888	H03D	California	1	1	Job Reference (optional)

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 5=-127

ENVISION NW

Roof

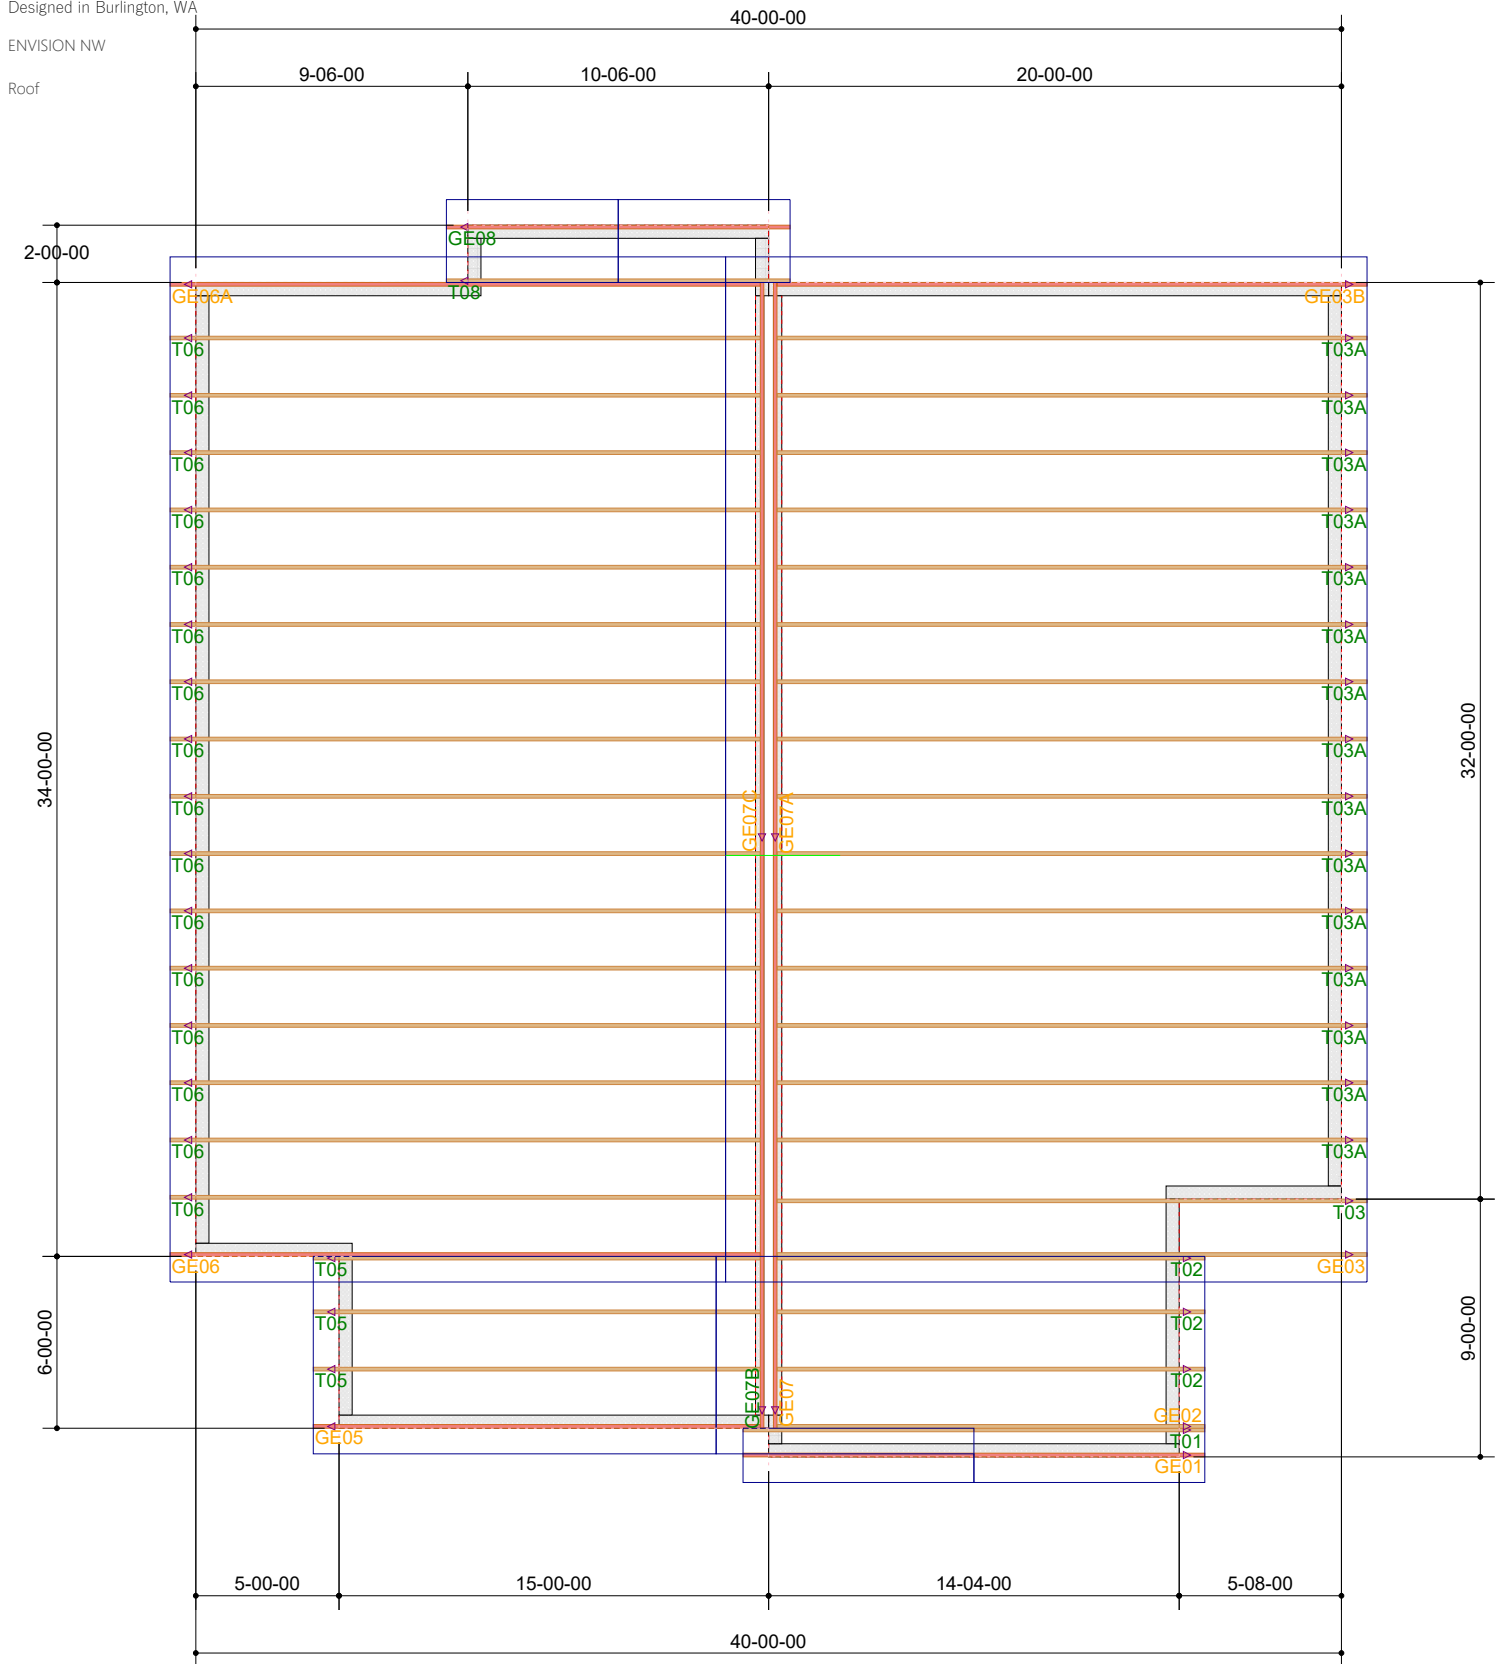

BID #1903888A

ENVISION NW

SILVERDALE, WA 98383-9521

Sales:
Jeremiah Murphy



Roof: 6.00/12 Overhang: 10-12

Ceiling: Flat Spacing: 24"

30 PSF SNOW LOAD


All Gables dropped for 2x4 outlookers

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE01	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:18 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-HqVfKPf0g0oha6o0YjWit9Nlm9MV6scU0Vhk2Oyyp9B



Scale = 1:27.1

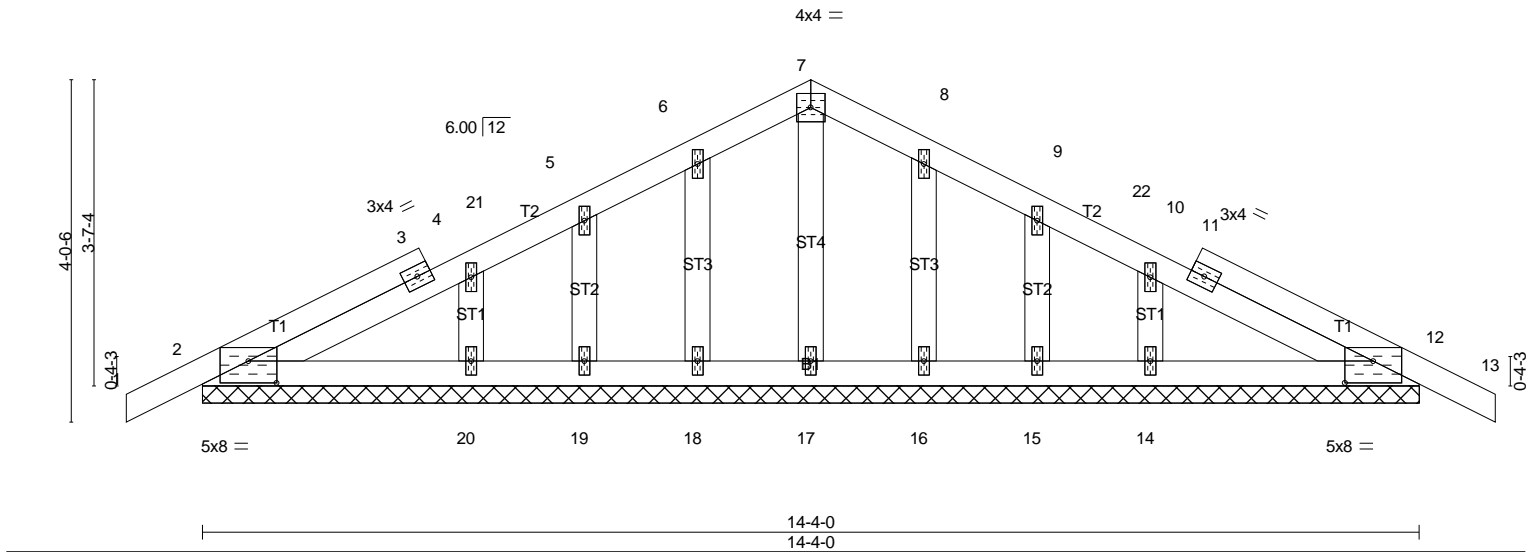


Plate Offsets (X,Y)-- [2:0-4-0,0-3-1], [12:0-4-0,0-3-1]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.07	Vert(LL)	0.00	12	n/r	120	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	0.00	12	n/r	90		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	12	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 68 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 14-4-0.
(lb) - Max Horz 2=-60(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 18, 19, 20, 16, 15, 14
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 18, 19, 20, 16, 15, 14

FORCES. (lb) - Max. Comp/Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-12 to 2-8-7, Exterior(2) 2-8-7 to 7-2-0, Corner(3) 7-2-0 to 10-9-3, Exterior(2) 10-9-3 to 15-2-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 18, 19, 20, 16, 15, 14.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE02	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:20 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-DCcQl5hGCd2PpQxOf8YAyaSyeyxQab_mUpAr7Gyyp99

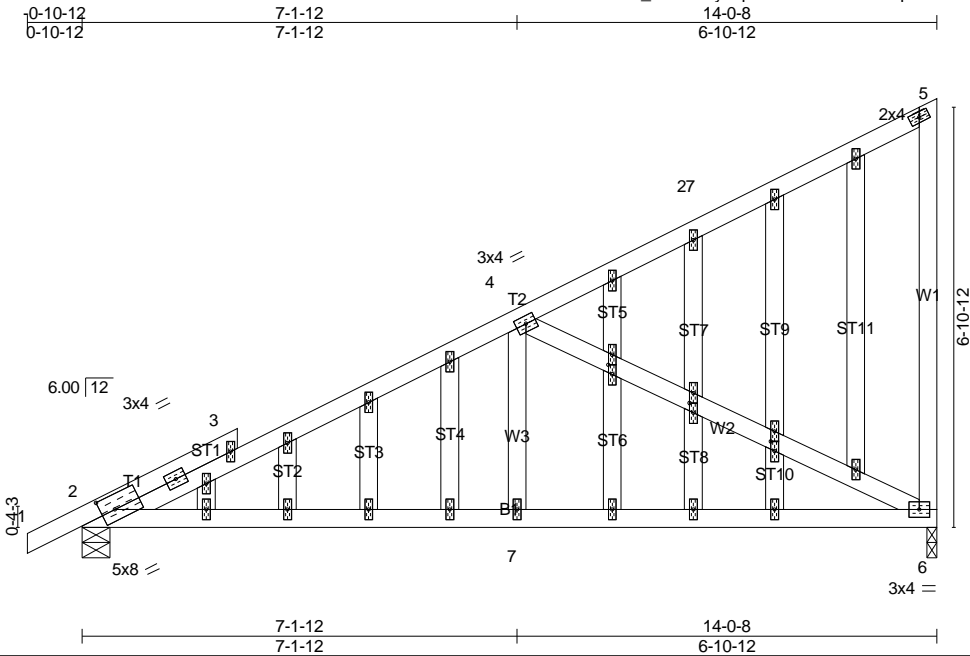


Plate Offsets (X,Y)-- [2:0-2-12,0-2-13], [12:0-1-14,0-0-12], [15:0-1-14,0-0-12], [18:0-1-14,0-0-12]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP
TCLL	30.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.08	2-7	>999	240	MT20 220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.14	2-7	>999	180	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.02	6	n/a	n/a	
BCDL	8.0	Code IRC2015/TPI2014		Matrix-SH							Weight: 100 lb FT = 0%

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 5-3-11 oc purlins, except end verticals.
BOT CHORD	2x4 DF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 DF No.2	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.	
OTHERS	2x4 DF No.2		

REACTIONS. (lb/size) 6=612/0-2-0 (min. 0-1-8), 2=702/0-5-8 (min. 0-1-8)
Max Horz 2=261(LC 9)
Max Uplift 6=162(LC 12), 2=129(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-953/134, 3-4=-874/152
BOT CHORD 2-7=-247/782, 6-7=-247/782
WEBS 4-7=0/293, 4-6=-853/263

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 13-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=162, 2=129.
 - 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 10) No notches allowed in overhang and 1012 from left end and 0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE03	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:23 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-dnIYN6j9UYQzgtgzLH6taD4UnA?Xn23DAnPVjbyyp96

0-10-12 5-10-12 12-7-14 19-8-8
0-10-12 5-10-12 6-9-2 7-0-10

Scale = 1:52.7

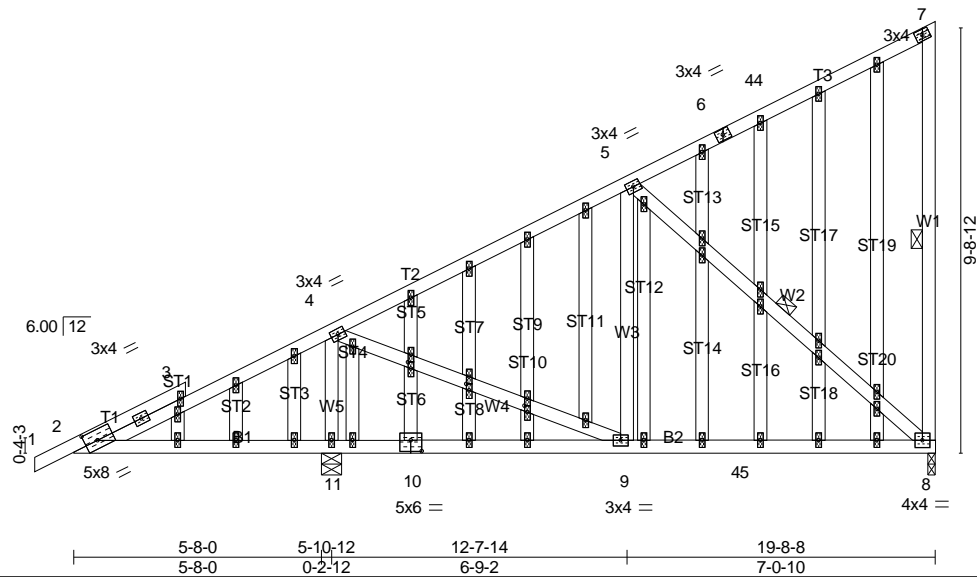


Plate Offsets (X,Y)-- [2:0-3-8,0-2-13], [10:0-3-0,0-3-0], [30:0-1-12,0-0-12], [31:0-1-12,0-0-12], [34:0-1-12,0-0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.05	8-9	>999	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.31	Vert(CT)	-0.10	8-9	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.33	Horz(CT)	-0.01	8	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
								Weight: 185 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 7-8, 5-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 8=470/0-2-0 (min. 0-1-8), 11=1357/0-5-8 (min. 0-1-8)
Max Horz 11=369(LC 9)
Max Uplift 8=161(LC 12), 11=239(LC 12)
Max Grav 8=476(LC 19), 11=1357(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-557/669, 3-4=-543/794, 4-5=-443/51
BOT CHORD 2-11=-623/565, 10-11=-702/555, 9-10=-702/555, 9-45=-170/310, 8-45=-170/310
WEBS 4-11=-1231/527, 4-9=-410/938, 5-8=-357/185


NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 1.5x4 MT20 unless otherwise indicated.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=161, 11=239.
- 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) No notches allowed in overhang and 1012 from left end and 0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.

LOAD CASE(S) Standard

Permit Number: 20-04898

Louws Truss, Inc., Ferndale, WA 98248

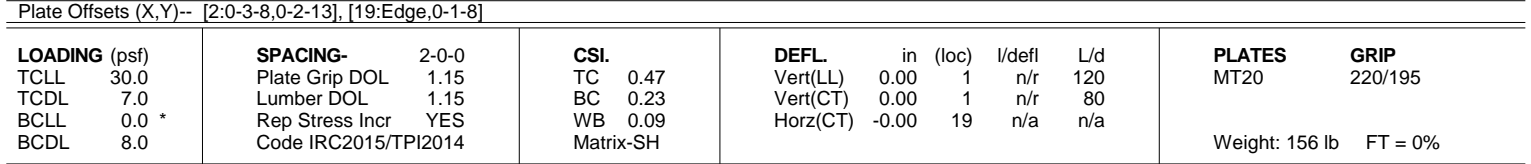

REACTIONS. All bearings 19-8-8.
(lb) - Max Horz 2=369(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 19, 2, 20, 21, 22, 23, 24, 25, 26,
27, 28, 29, 31, 32, 33
Max Grav All reactions 250 lb or less at joint(s) 19, 2, 20, 21, 22, 23, 24, 25, 26,
27, 28, 29, 31, 32, 33

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-543/267, 3-4=-530/257, 4-5=-529/264, 5-6=-503/257, 6-7=-471/245, 7-8=-441/235,
8-9=-410/224, 9-10=-379/214, 10-11=-348/203, 11-12=-318/192, 12-13=-287/182,
13-14=-257/163, 14-15=-252/171

- LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE05	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:29 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyz1pO-SxfqeAov4OA7Oo77hXCHpUKc6a5MBqN5YisqxFyyp90

7-0-6
6-7-4
0-10-12
13-2-0
13-2-0
14-8-8
1-6-8

4x4 =

Scale = 1:38.5

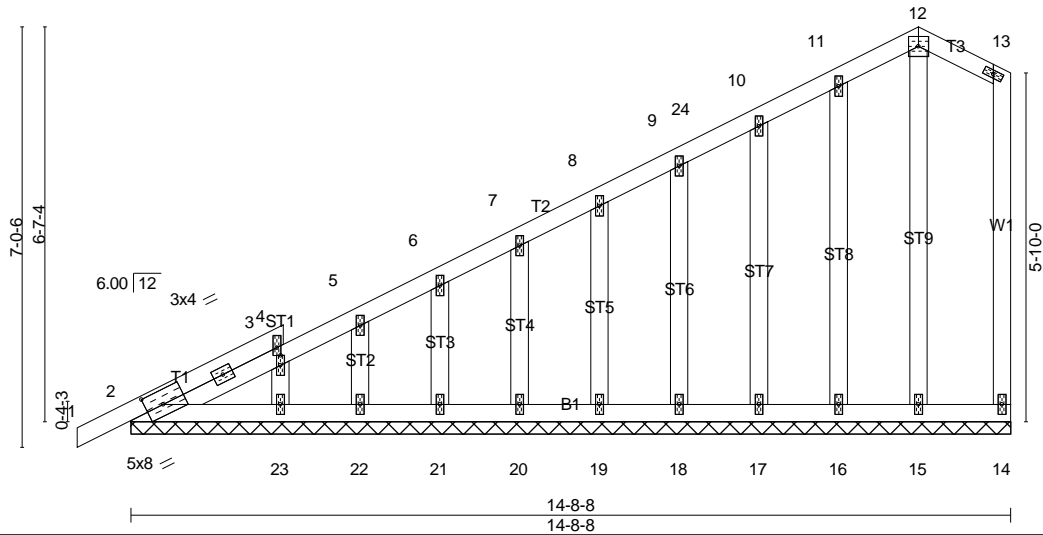


Plate Offsets (X,Y)-- [2:0-3-8,0-2-13], [3:0-1-9,0-0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	0.00	1	n/r	120	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	0.00	1	n/r	90		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	14	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 96 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 14-8-8.
(lb) - Max Horz 2=229(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 14, 2, 15, 16, 17, 18, 19, 20, 21, 22, 23
Max Grav All reactions 250 lb or less at joint(s) 14, 2, 15, 16, 17, 18, 19, 20, 21, 22, 23

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-324/167, 3-4=-299/151, 4-5=-299/158, 5-6=-270/151


NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-12 to 2-5-3, Exterior(2) 2-5-3 to 13-2-0, Corner(3) 13-2-0 to 14-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 2, 15, 16, 17, 18, 19, 20, 21, 22, 23.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- No notches allowed in overhang and 1012 from left end and 0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.

LOAD CASE(S) Standard

Permit Number: 20-04898

Louws Truss, Inc., Ferndale, WA 98248



LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 4-3-14 oc purlins, except end verticals.
BOT CHORD	2x4 DF No.2	BOT CHORD	Rigid ceiling directly applied or 9-9-6 oc bracing.
WEBS	2x4 DF No.2	WEBS	1 Row at midpt 7-10, 8-9, 7-9
OTHERS	2x4 DF No.2		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1426/251, 3-4=-1361/268, 4-5=-1031/212, 5-6=-1326/464, 6-7=-1219/478
 BOT CHORD 2-14=-382/1218, 13-14=-382/1218, 12-13=-382/1218, 11-12=-382/1218, 10-11=-382/1218
 WEBS 4-10=-509/246, 5-10=-647/341, 7-10=-514/1428, 7-9=-803/430

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE06A	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:36 2019 Page 1
 ID:t9rACx?uLBINQU_rXimwntyzy1pO-IHaT6ZtIRY37ktATbVqwby7kmPQQKx679l2hgLyyp8v



Scale = 1:61.4

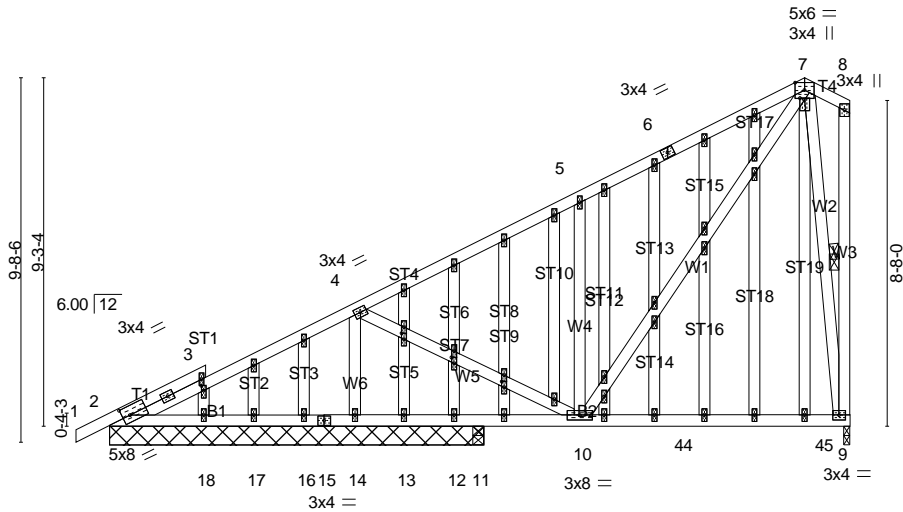


Plate Offsets (X,Y)--	[2:0-2-8,0-2-13], [7:0-0-8,0-1-8], [36:0-1-14,0-0-12], [37:0-1-14,0-0-12], [39:0-1-14,0-0-12], [43:0-1-9,0-0-12]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.48	Vert(LL)	-0.09 9-10	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.15 9-10	>798	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.27	Horz(CT)	-0.00 9	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH						
									Weight: 196 lb FT = 0%

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
WEBS 2x4 DF No.2	10-0-0 oc bracing: 9-10.
OTHERS 2x4 DF No.2	WEBS 1 Row at midpt 8-9, 7-9
<div>MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.</div>	

REACTIONS. All bearings 9-11-8 except (jt=length) 9=0-2-0, 11=0-3-8.
(lb) - Max Horz 2=334(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 17, 18 except 14=325(LC 12), 9=113(LC 12), 11=128(LC 18)
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 13, 16, 17, 18, 11 except 14=1002(LC 1), 9=520(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-340/291, 3-4=-327/407, 4-5=-467/102, 5-6=-443/190, 6-7=-356/204
BOT CHORD 2-18=-302/165, 17-18=-302/165, 16-17=-302/165, 15-16=-302/165, 14-15=-302/165, 13-14=-302/165, 12-13=-302/165, 11-12=-302/165, 10-11=-302/165
WEBS 4-14=-987/341, 4-10=-123/592, 5-10=-467/243, 7-10=-152/377, 7-9=-490/342

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-12 to 2-8-7, Interior(1) 2-8-7 to 18-6-0, Exterior(2) 18-6-0 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 9.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 17, 18 except (jt=lb) 14=325, 9=113, 11=128.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE06A	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:36 2019 Page 2
ID:t9rACx?uLBINQU_rXimwntyZ1pO-IHaT6ZtlRY37ktATbVqwby7kmPQQKx679l2hgLyyp8v

NOTES-
11) No notches allowed in overhang and 1012 from left end and 0 from right end or 12" along rake from scarf, whichever is larger. Minimum 1.5x4 tie plates required at 2-0-0 o.c. maximum between the stacking chords. For edge-wise notching, provide at least one tie plate between each notch.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE07	GABLE	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

ID:t9rACx?uLBINQU_rXimwntyZ1pO-e2q_ywwpUmZZDUTEqLvsmoHPv0pHG0qj4w0vp6yyp8r
 8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:40 2019 Page 1

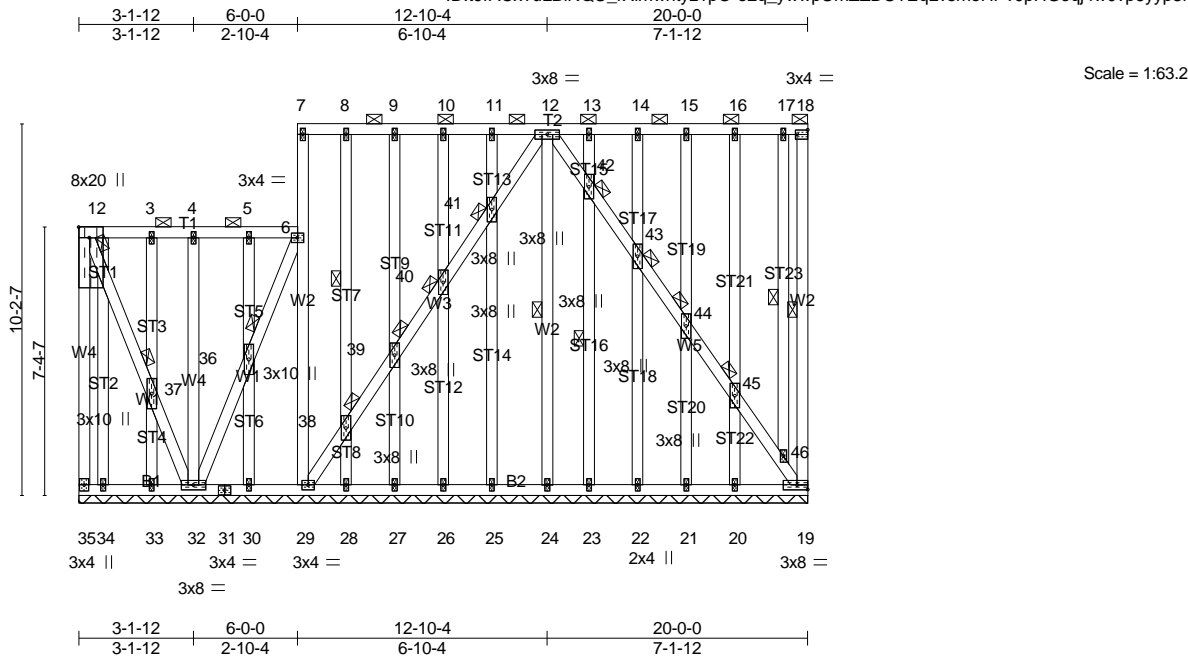


Plate Offsets (X,Y)-- [1:Edge,0-3-8], [2:0-0-0,0-1-12], [18:Edge,0-1-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	30.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	n/a	-	n/a	999	MT20	220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.10	Horz(CT)	-0.01	19	n/a	n/a		
BCDL	8.0	Code IRC2015/TPI2014		Matrix-SH							Weight: 306 lb	FT = 0%

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-6, 6-29, 7-18.
BOT CHORD	2x4 DF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 9-3-9 oc bracing: 34-35 6-0-0 oc bracing: 33-34,32-33.
WEBS	2x4 DF No.2	WEBS	1 Row at midpt 18-19, 12-24, 8-38, 23-42, 17-46
OTHERS	2x4 DF No.2	JOINTS	1 Brace at Jt(s): 1, 18, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45
		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.	

REACTIONS. All bearings 20-0-0.
 (lb) - Max Horz 35=323(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 19, 32, 24, 30, 33, 34, 28, 27, 26, 25, 23, 22, 21, 20 except 35=-223(LC 10), 29=-116(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 35, 29, 19, 32, 24, 30, 33, 34, 28, 27, 26, 25, 23, 22, 21, 20

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 BOT CHORD 34-35=-442/464, 33-34=-443/465, 32-33=-443/465, 31-32=-322/371, 30-31=-322/371, 29-30=-322/371
 WEBS 1-37=-238/283

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) interior zone and C-C Corner(3) 0-4-14 to 4-0-1, Exterior(2) 4-0-1 to 6-1-12, Corner(3) 6-1-12 to 10-0-0, Exterior(2) 10-0-0 to 19-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19, 32, 24, 30, 33, 34, 28, 27, 26, 25, 23, 22, 21, 20 except (jt=lb) 35=223, 29=116.


Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE07	GABLE	1	1	Job Reference (optional)

- NOTES-**
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Louws Truss, Inc., Ferndale, WA 98248

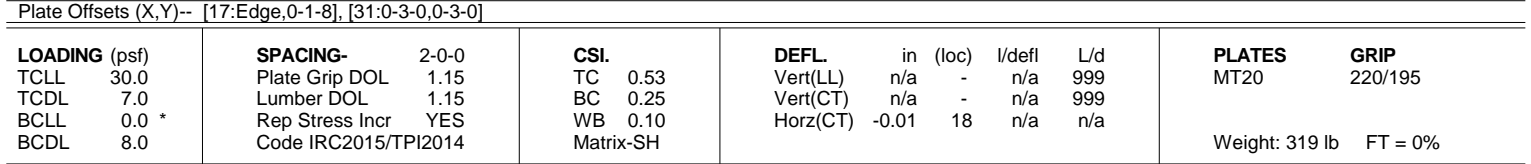

REACTIONS. All bearings 20-0-0.
(lb) - Max Horz 34=346(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 18, 26, 33, 32, 31, 30, 29, 28, 27,
25, 24, 23, 22, 21, 20, 19 except 34=-158(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 34, 18, 26, 33, 32, 31, 30, 29,
28, 27, 25, 24, 23, 22, 21, 20, 19

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-0-0, Exterior(2) 4-0-0 to 19-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18, 26, 33, 32, 31, 30, 29, 28, 27, 25, 24, 23, 22, 21, 20, 19 except (jt=lb) 34=158.
- 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE07B	Roof Special Supported Gable	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248
 ID:t9rACx?uLBINQU_rXimwnty1pO-wPldQK0CrwSaZZVbkJXVYH4XKr8BPwwlhWDmZCyp8k
 8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:47 2019 Page 1

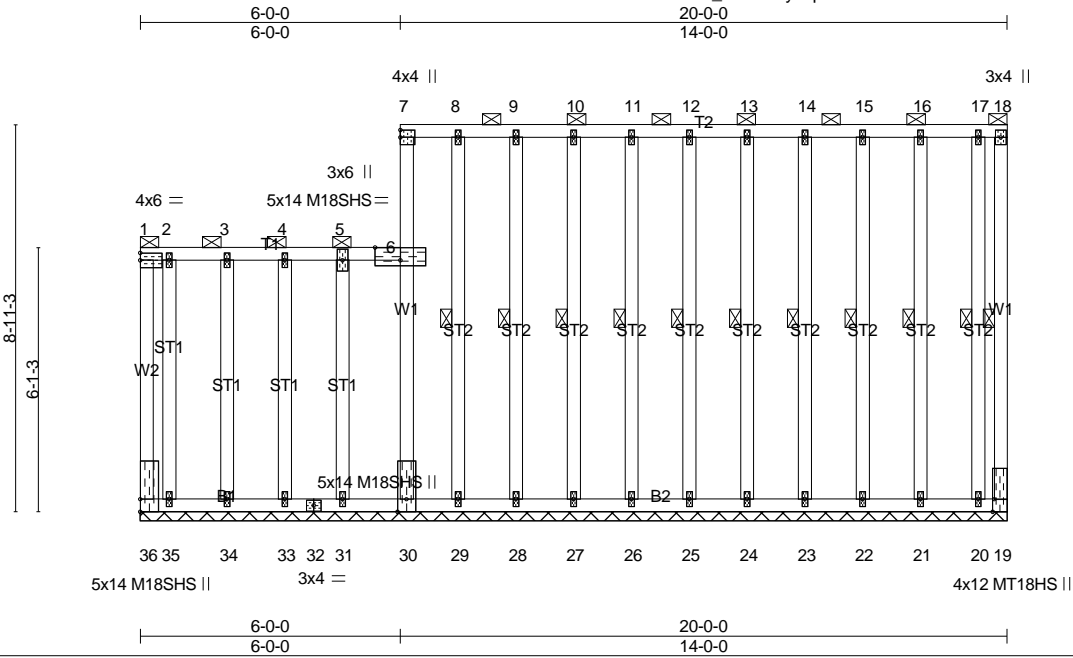


Plate Offsets (X,Y)-- [6:0-7-0,Edge], [19:0-3-8,Edge]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	30.0	Plate Grip DOL	1.15	TC	0.78	Vert(LL)	n/a - n/a	999	MT20 220/195
TCDL	7.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	n/a - n/a	999	M18SHS 220/195
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.27	Horz(CT)	-0.00 19	n/a n/a	MT18HS 220/195
BCDL	8.0	Code IRC2015/TPI2014		Matrix-R					Weight: 227 lb FT = 0%

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-6, 6-30, 7-18.
BOT CHORD	2x4 DF No.2	BOT CHORD	Rigid ceiling directly applied or 9-8-12 oc bracing.
WEBS	2x4 DF No.2	WEBS	1 Row at midpt 18-19, 8-29, 9-28, 10-27, 11-26, 12-25, 13-24, 14-23, 15-22, 16-21, 17-20
OTHERS	2x4 DF No.2		

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. All bearings 20-0-0.
 (lb) - Max Horz 36=-302(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 33, 34, 28, 27, 26, 25, 24, 23, 22, 21 except 36=-800(LC 10), 30=-114(LC 9), 19=-505(LC 11), 31=-457(LC 8), 35=-753(LC 9), 29=-312(LC 9), 20=-512(LC 8)
 Max Grav All reactions 250 lb or less at joint(s) 30, 33, 34, 28, 27, 26, 25, 24, 23, 22, 21 except 36=755(LC 9), 19=475(LC 8), 31=458(LC 11), 35=803(LC 10), 29=277(LC 19), 20=538(LC 11)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-36=-359/364, 6-30=-253/270
 BOT CHORD 35-36=-291/311, 34-35=-291/311, 33-34=-291/311, 32-33=-291/311, 31-32=-291/311, 30-31=-291/311
 WEBS 5-31=-521/536, 2-35=-309/311

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 3-8-15, Exterior(2) 3-8-15 to 6-1-12, Corner(3) 6-1-12 to 10-0-0, Exterior(2) 10-0-0 to 19-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE07B	Roof Special Supported Gable	1	1	Job Reference (optional)


Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:47 2019 Page 2
ID:t9rACx?uLBINQU_rXimwnty1pO-wPldQK0CrwSaZZVbkJXVYH4XKr8BPwwlhWDmZCYyp8k

- NOTES-**
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 33, 34, 28, 27, 26, 25, 24, 23, 22, 21 except (jt=lb) 36=800, 30=114, 19=505, 31=457, 35=753, 29=312, 20=512.
 - 13) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Louws Truss, Inc., Ferndale, WA 98248




<p>LUMBER-</p> <p>TOP CHORD 2x4 DF No.2</p> <p>BOT CHORD 2x4 DF No.2</p> <p>WEBS 2x4 DF No.2</p> <p>OTHERS 2x4 DF No.2</p>	<p>BRACING-</p> <p>TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-17, except end verticals.</p> <p>BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.</p> <p>WEBS 1 Row at midpt 1-34, 17-18, 6-29, 12-23</p> <p>JOINTS 1 Brace at Jt(s): 1, 17, 36, 37, 38, 39, 42, 43, 44, 45</p>
<p>MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.</p>	

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	GE08	Common Supported Gable	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:54 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty21pO-DlgGuj5bB4KaueYxfH98Klsvife3Y8Unl5Qellyyp8d

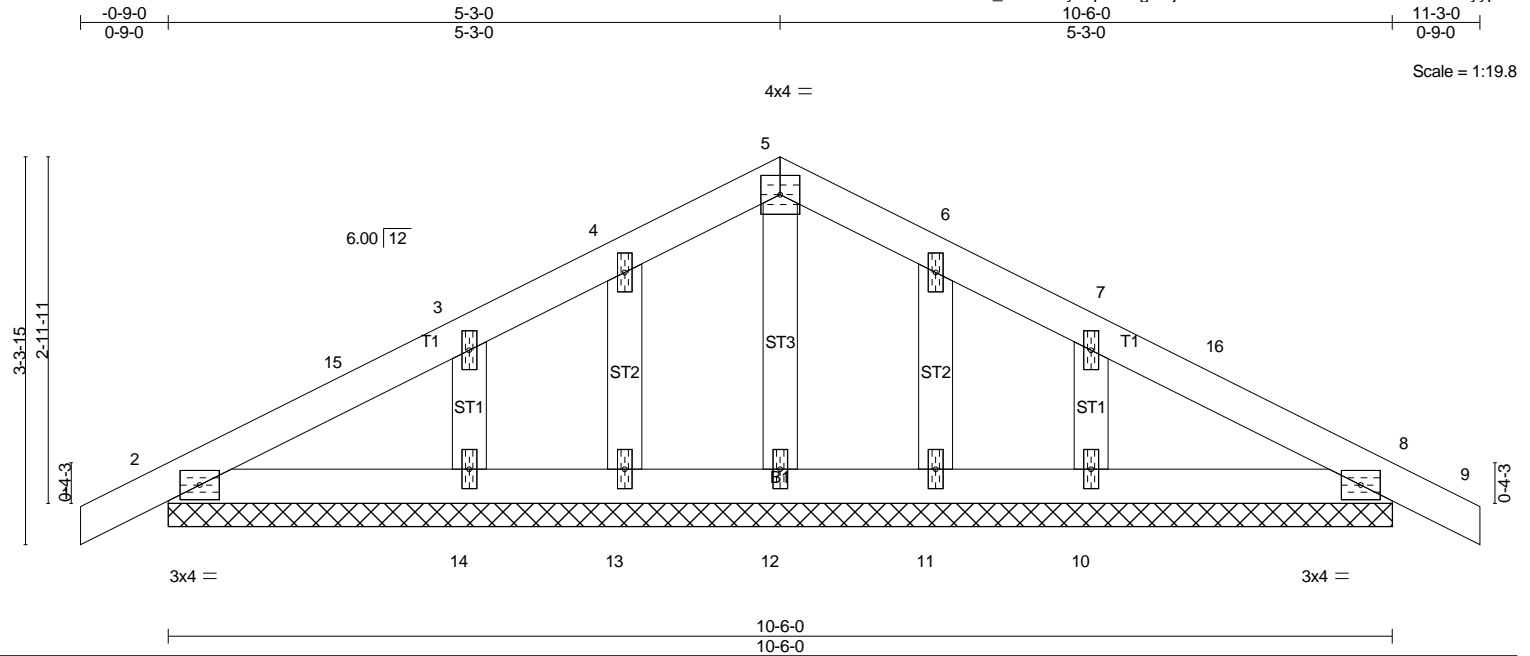

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.06	Vert(LL)	0.00	8	n/r	120	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	0.00	9	n/r	90		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	8	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH							
	Code IRC2015/TPI2014								
								Weight: 44 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
OTHERS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 10-6-0.
(lb) - Max Horz 2=48(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-9-0 to 2-7-0, Exterior(2) 2-7-0 to 5-3-0, Corner(3) 5-3-0 to 8-10-3, Exterior(2) 8-10-3 to 11-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T01	Common	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:56 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty31pO-A7n1JO7rjha18yhJmiBcPAy6DTDa02W3mPvINByp8b

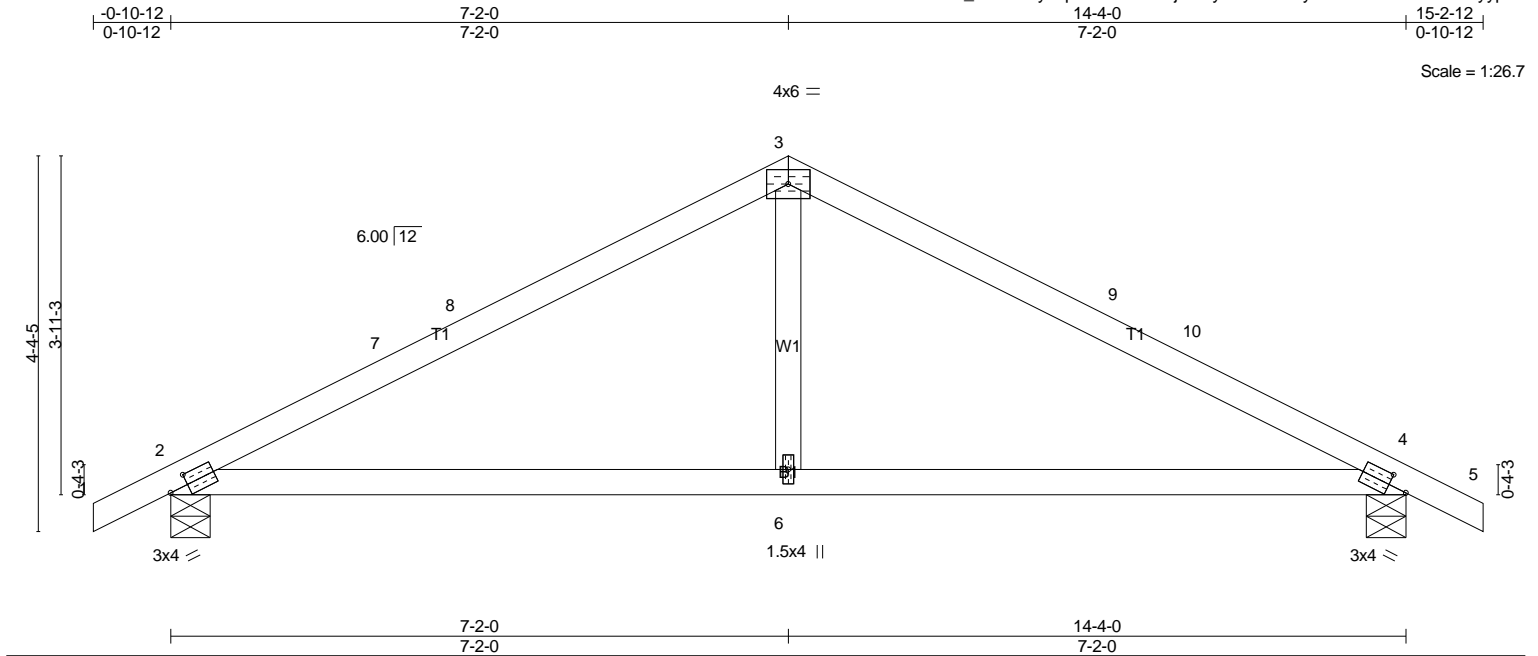


Plate Offsets (X,Y)--		[2:0-2-10,0-1-8], [4:0-2-10,0-1-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 30.0	Plate Grip DOL	1.15	TC 0.70
TCDL 7.0	Lumber DOL	1.15	BC 0.48
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH
			DEFL. in (loc) l/defl L/d
			Vert(LL) -0.08 4-6 >999 240
			Vert(CT) -0.13 4-6 >999 180
			Horz(CT) 0.01 4 n/a n/a
			PLATES GRIP
			MT20 220/195
			Weight: 49 lb FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 4-10-14 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=708/0-5-8 (min. 0-1-8), 4=708/0-5-8 (min. 0-1-8)
Max Horz 2=65(LC 12)
Max Uplift2=-126(LC 12), 4=-126(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-890/160, 7-8=-776/164, 3-8=-771/178, 3-9=-771/178, 9-10=-776/164,
4-10=-890/160

BOT CHORD 2-6=-57/683, 4-6=-57/683

WEBS 3-6=0/297

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 7-2-0, Exterior(2) 7-2-0 to 10-9-3, Interior(1) 10-9-3 to 15-2-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=126, 4=126.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T02	Monopitch	3	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:28:58 2019 Page 1
ID:t9rACx?uLBINQU_rXimwntyZ1pO-6Wvnk486Flq0NFriu7E4Ub1SjHwAUo0MDjOsS3yyp8Z

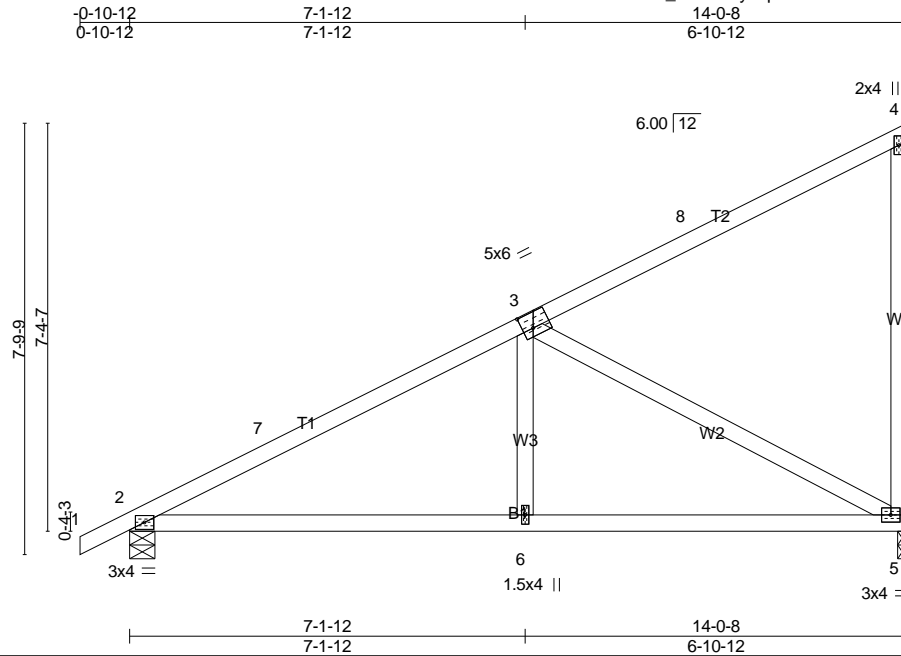

Scale = 1:41.6

Plate Offsets (X,Y)-- [3:0-2-4,0-3-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	2-0-0	TC 0.64	Vert(LL)	-0.06	2-6	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.41	Vert(CT)	-0.11	2-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.01	5	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 66 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-11 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 5=612/0-2-0 (min. 0-1-8), 2=702/0-5-8 (min. 0-1-8)
Max Horz 2=273(LC 9)
Max Uplift 5=165(LC 12), 2=126(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-891/127, 3-7=-785/145
BOT CHORD 2-6=-245/696, 5-6=-248/690
WEBS 3-6=0/290, 3-5=-775/255

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 13-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=165, 2=126.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T03	Monopitch	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:29:01 2019 Page 1

ID:t9rACx?uLBINQU_rXimwntyzt1pO-W5bwM6A_YDCaEjaHZFnn6DfzXUzShF7pvhcW2Oyyp8W

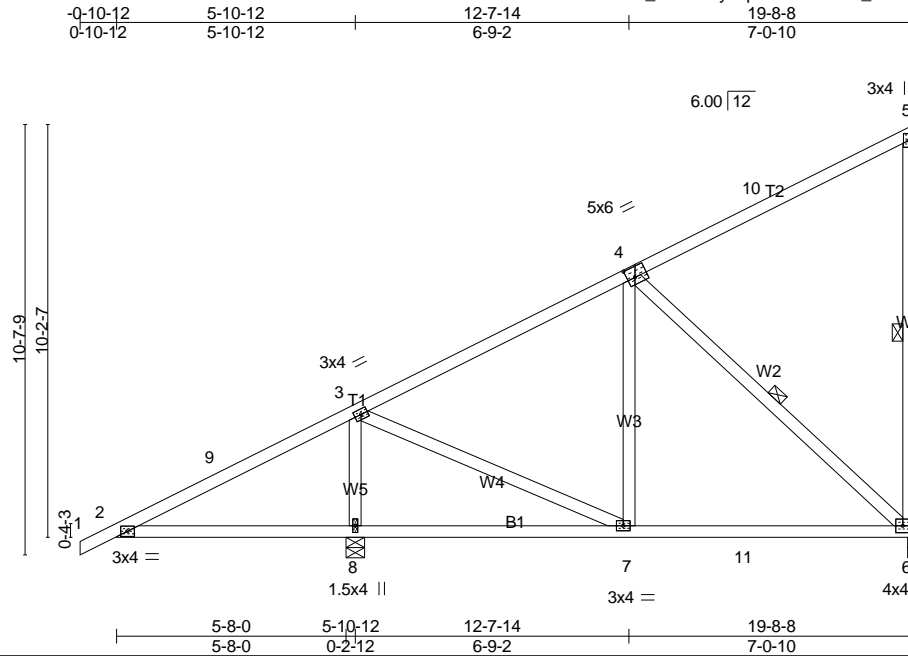

Scale = 1:56.9

Plate Offsets (X,Y)-- [4:0-2-4,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.60	Vert(LL)	-0.05	6-7	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.10	6-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.28	Horz(CT)	-0.01	6	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 105 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 5-6, 4-6

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 6=470/0-2-0 (min. 0-1-8), 8=1357/0-5-8 (min. 0-1-8)
Max Horz 8=381(LC 9)
Max Uplift 6=-165(LC 12), 8=-234(LC 12)
Max Grav 6=482(LC 19), 8=1357(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-9=-496/605, 3-9=-488/717, 3-4=-432/52
BOT CHORD 2-8=-540/508, 7-8=-651/495, 7-11=-179/303, 6-11=-179/303
WEBS 3-8=-1223/520, 3-7=-345/841, 4-6=-352/189

NOTES-

- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=165, 8=234.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T03A	Monopitch	15	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

ID:t9rACx?uLBINQU_rXimwnty1pO-SUjgnoCE4rTIT1kfggpFBekK6lYW99P5N?5d7Hyyp8U
 8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:29:03 2019 Page 1

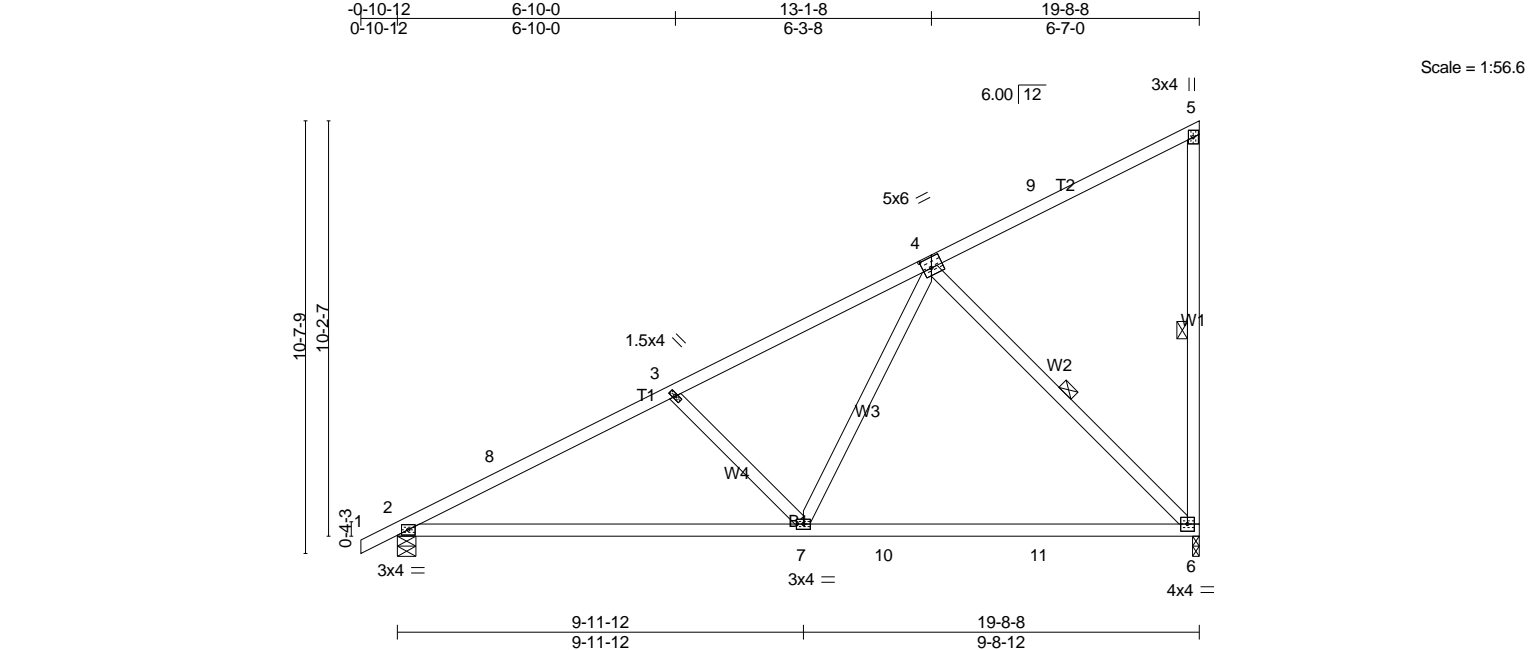


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES	
TCLL	30.0	Plate Grip DOL	2-0-0	TC	0.53	in (loc)	l/defl	MT20	GRIP
TCDL	7.0	Lumber DOL	1.15	BC	0.71	6-7	>783		220/195
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.30	6-7	>534		
BCDL	8.0	Code IRC2015/TPI2014		Matrix-SH		6	n/a		
								Weight: 99 lb FT = 0%	

LUMBER-		BRACING-	
TOP CHORD	2x4 DF No.2	TOP CHORD	Structural wood sheathing directly applied or 4-4-7 oc purlins, except end verticals.
BOT CHORD	2x4 DF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 DF No.2	WEBS	1 Row at midpt 5-6, 4-6
		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.	

REACTIONS. (lb/size) 6=868/0-2-0 (min. 0-1-8), 2=956/0-5-8 (min. 0-1-8)
 Max Horz 2=381(LC 9)
 Max Uplift 6=-234(LC 12), 2=-167(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-1405/214, 3-8=-1308/229, 3-4=-1054/204
 BOT CHORD 2-7=-366/1159, 7-10=-250/603, 10-11=-250/603, 6-11=-250/603
 WEBS 3-7=-448/230, 4-7=-84/587, 4-6=-849/293

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 19-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
 - 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=234, 2=167.
 - 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T05	Common	3	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248 8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:29:05 2019 Page 1
ID:t9rACx?uLBINQU_rXimwnty1pO-PsqRCTEVbSJ0jKt2o5sjH3qgS5Jnd1?OqJajB9yyp8S

0-10-12 6-10-4 13-2-0 14-8-8
0-10-12 6-10-4 6-3-12 1-6-8

5x6 = Scale = 1:40.3

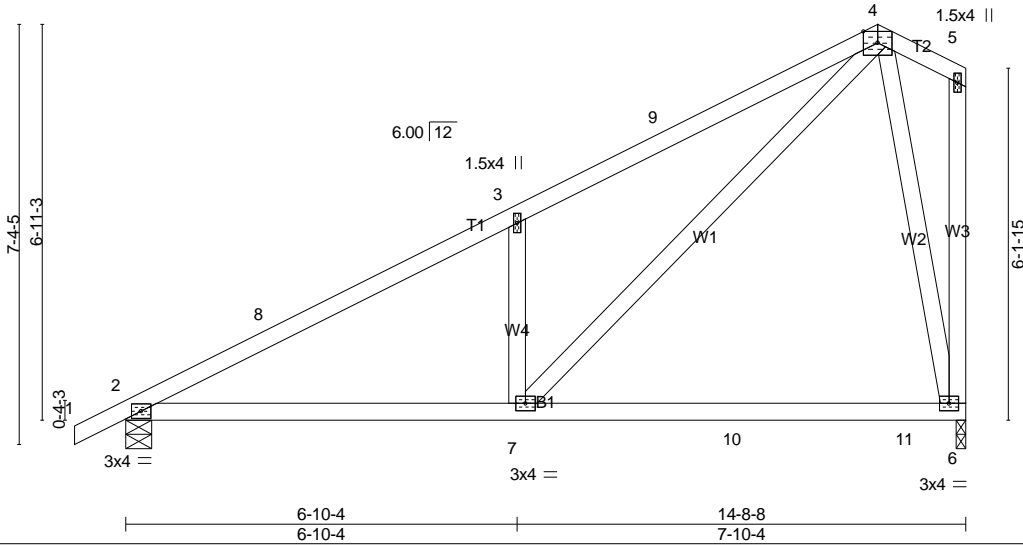

LOADING (psf)	SPACING-	CS.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.54	Vert(LL) -0.11	6-7	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.41	Vert(CT) -0.17	6-7	>983	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.42	Horz(CT) 0.01	6	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014						Weight: 77 lb	FT = 0%

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.2	TOP CHORD Structural wood sheathing directly applied or 5-7-12 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 DF No.2	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=731/0-5-8 (min. 0-1-8), 6=642/0-2-0 (min. 0-1-8)
Max Horz 2=241(LC 11)
Max Uplift2=-137(LC 12), 6=-144(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-8=-978/141, 3-8=-877/157, 3-9=-988/270, 4-9=-868/291
BOT CHORD 2-7=-263/777
WEBS 3-7=-522/274, 4-7=-290/935, 4-6=-615/314

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 13-2-0, Exterior(2) 13-2-0 to 14-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=137, 6=144.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T06	Common	16	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

ID:t9rACx?uLBINQU_rXimwnty1pO-pRWZqVGNuN5baocdTEPQuiSC1JJpqLWrwHpOoUyyp8P

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:29:08 2019 Page 1

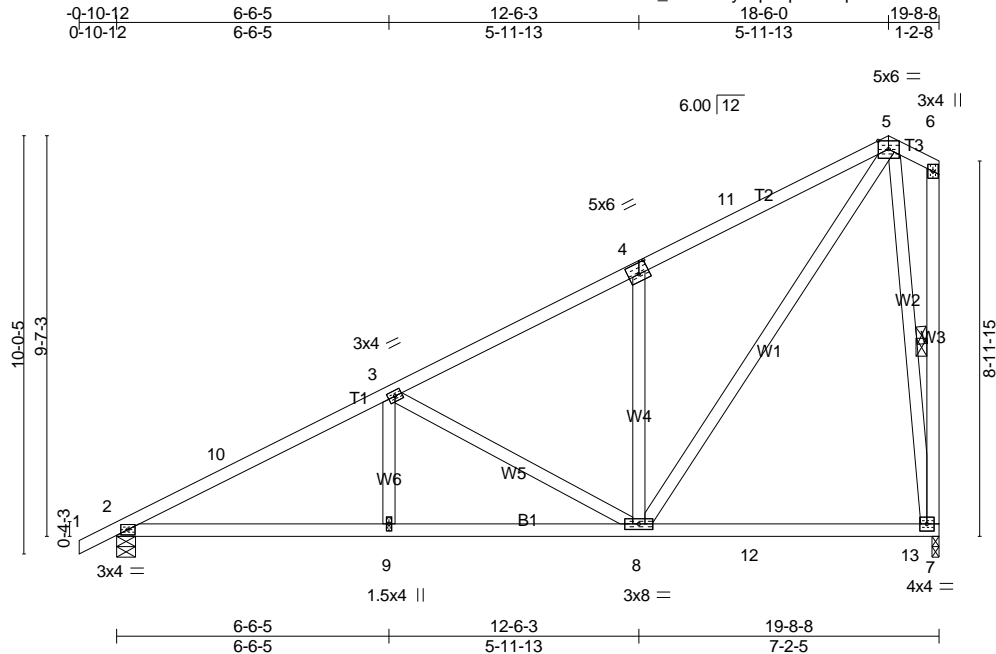

Scale = 1:55.2

Plate Offsets (X,Y)-- [4:0-3-0,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 30.0	Plate Grip DOL	1.15	TC 0.46	Vert(LL)	-0.11	7-8	>999	240	MT20	220/195
TCDL 7.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.17	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.63	Horz(CT)	0.02	7	n/a	n/a		
BCDL 8.0	Code IRC2015/TPI2014		Matrix-SH							
									Weight: 118 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-7, 5-7

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=956/0-5-8 (min. 0-1-8), 7=868/0-2-0 (min. 0-1-8)
Max Horz 2=347(LC 9)
Max Uplift 2=-172(LC 12), 7=-211(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-1459/207, 3-10=-1359/222, 3-4=-841/185, 4-11=-851/273, 5-11=-741/286
BOT CHORD 2-9=-365/1204, 8-9=-365/1204
WEBS 3-8=-618/206, 4-8=-465/241, 5-8=-331/1037, 5-7=-858/424

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-12 to 2-8-7, Interior(1) 2-8-7 to 18-6-0, Exterior(2) 18-6-0 to 19-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 8.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 7.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=172, 7=211.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Permit Number: 20-04898

Job	Truss	Truss Type	Qty	Ply	ENVISION NW
1903888A	T08	Common	1	1	Job Reference (optional)

Louws Truss, Inc., Ferndale, WA 98248

8.310 s Jun 26 2019 MiTek Industries, Inc. Fri Jul 12 10:29:10 2019 Page 1

ID:t9rACx?uLBINQU_rXimwnty1pO-lqeKFBHdQ_LJp6m0beSu_7XaZ63PIOD7_bIUtNyyp8N

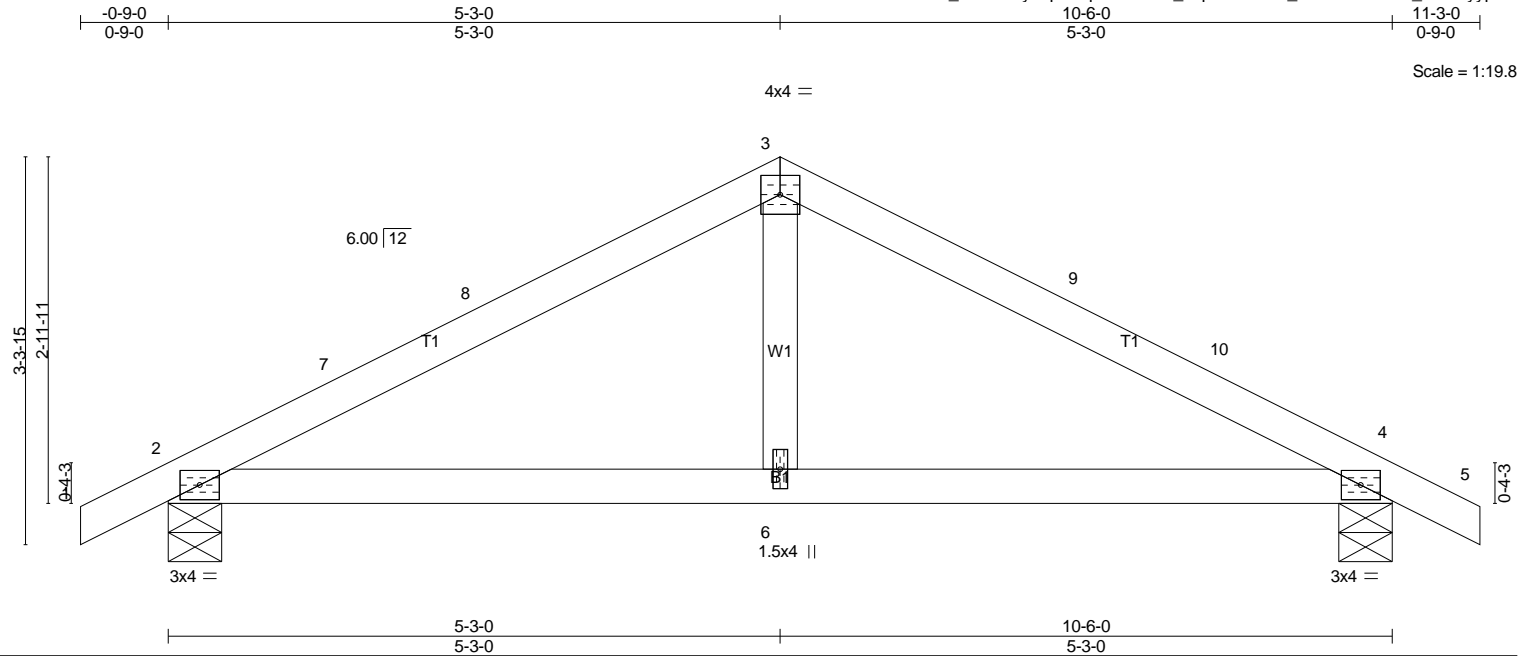

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 30.0	2-0-0	TC 0.33	Vert(LL) -0.02	2-6	>999	240	MT20	220/195
TCDL 7.0	Plate Grip DOL 1.15	BC 0.25	Vert(CT) -0.04	2-6	>999	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Horz(CT) 0.01	4	n/a	n/a		
BCDL 8.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2015/TPI2014						Weight: 36 lb	FT = 0%

LUMBER-

TOP CHORD 2x4 DF No.2
BOT CHORD 2x4 DF No.2
WEBS 2x4 DF No.2

BRACING-

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=524/0-5-8 (min. 0-1-8), 4=524/0-5-8 (min. 0-1-8)
Max Horz 2=48(LC 16)
Max Uplift 2=-95(LC 12), 4=-95(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-630/144, 7-8=-542/148, 3-8=-539/159, 3-9=-539/159, 9-10=-542/148,
4-10=-630/145
BOT CHORD 2-6=-53/478, 4-6=-53/478

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=110mph (3-second gust) Vasd=87mph; TCDL=4.2psf; BCDL=4.8psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-0 to 2-10-3, Interior(1) 2-10-3 to 5-3-0, Exterior(2) 5-3-0 to 8-10-3, Interior(1) 8-10-3 to 11-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard